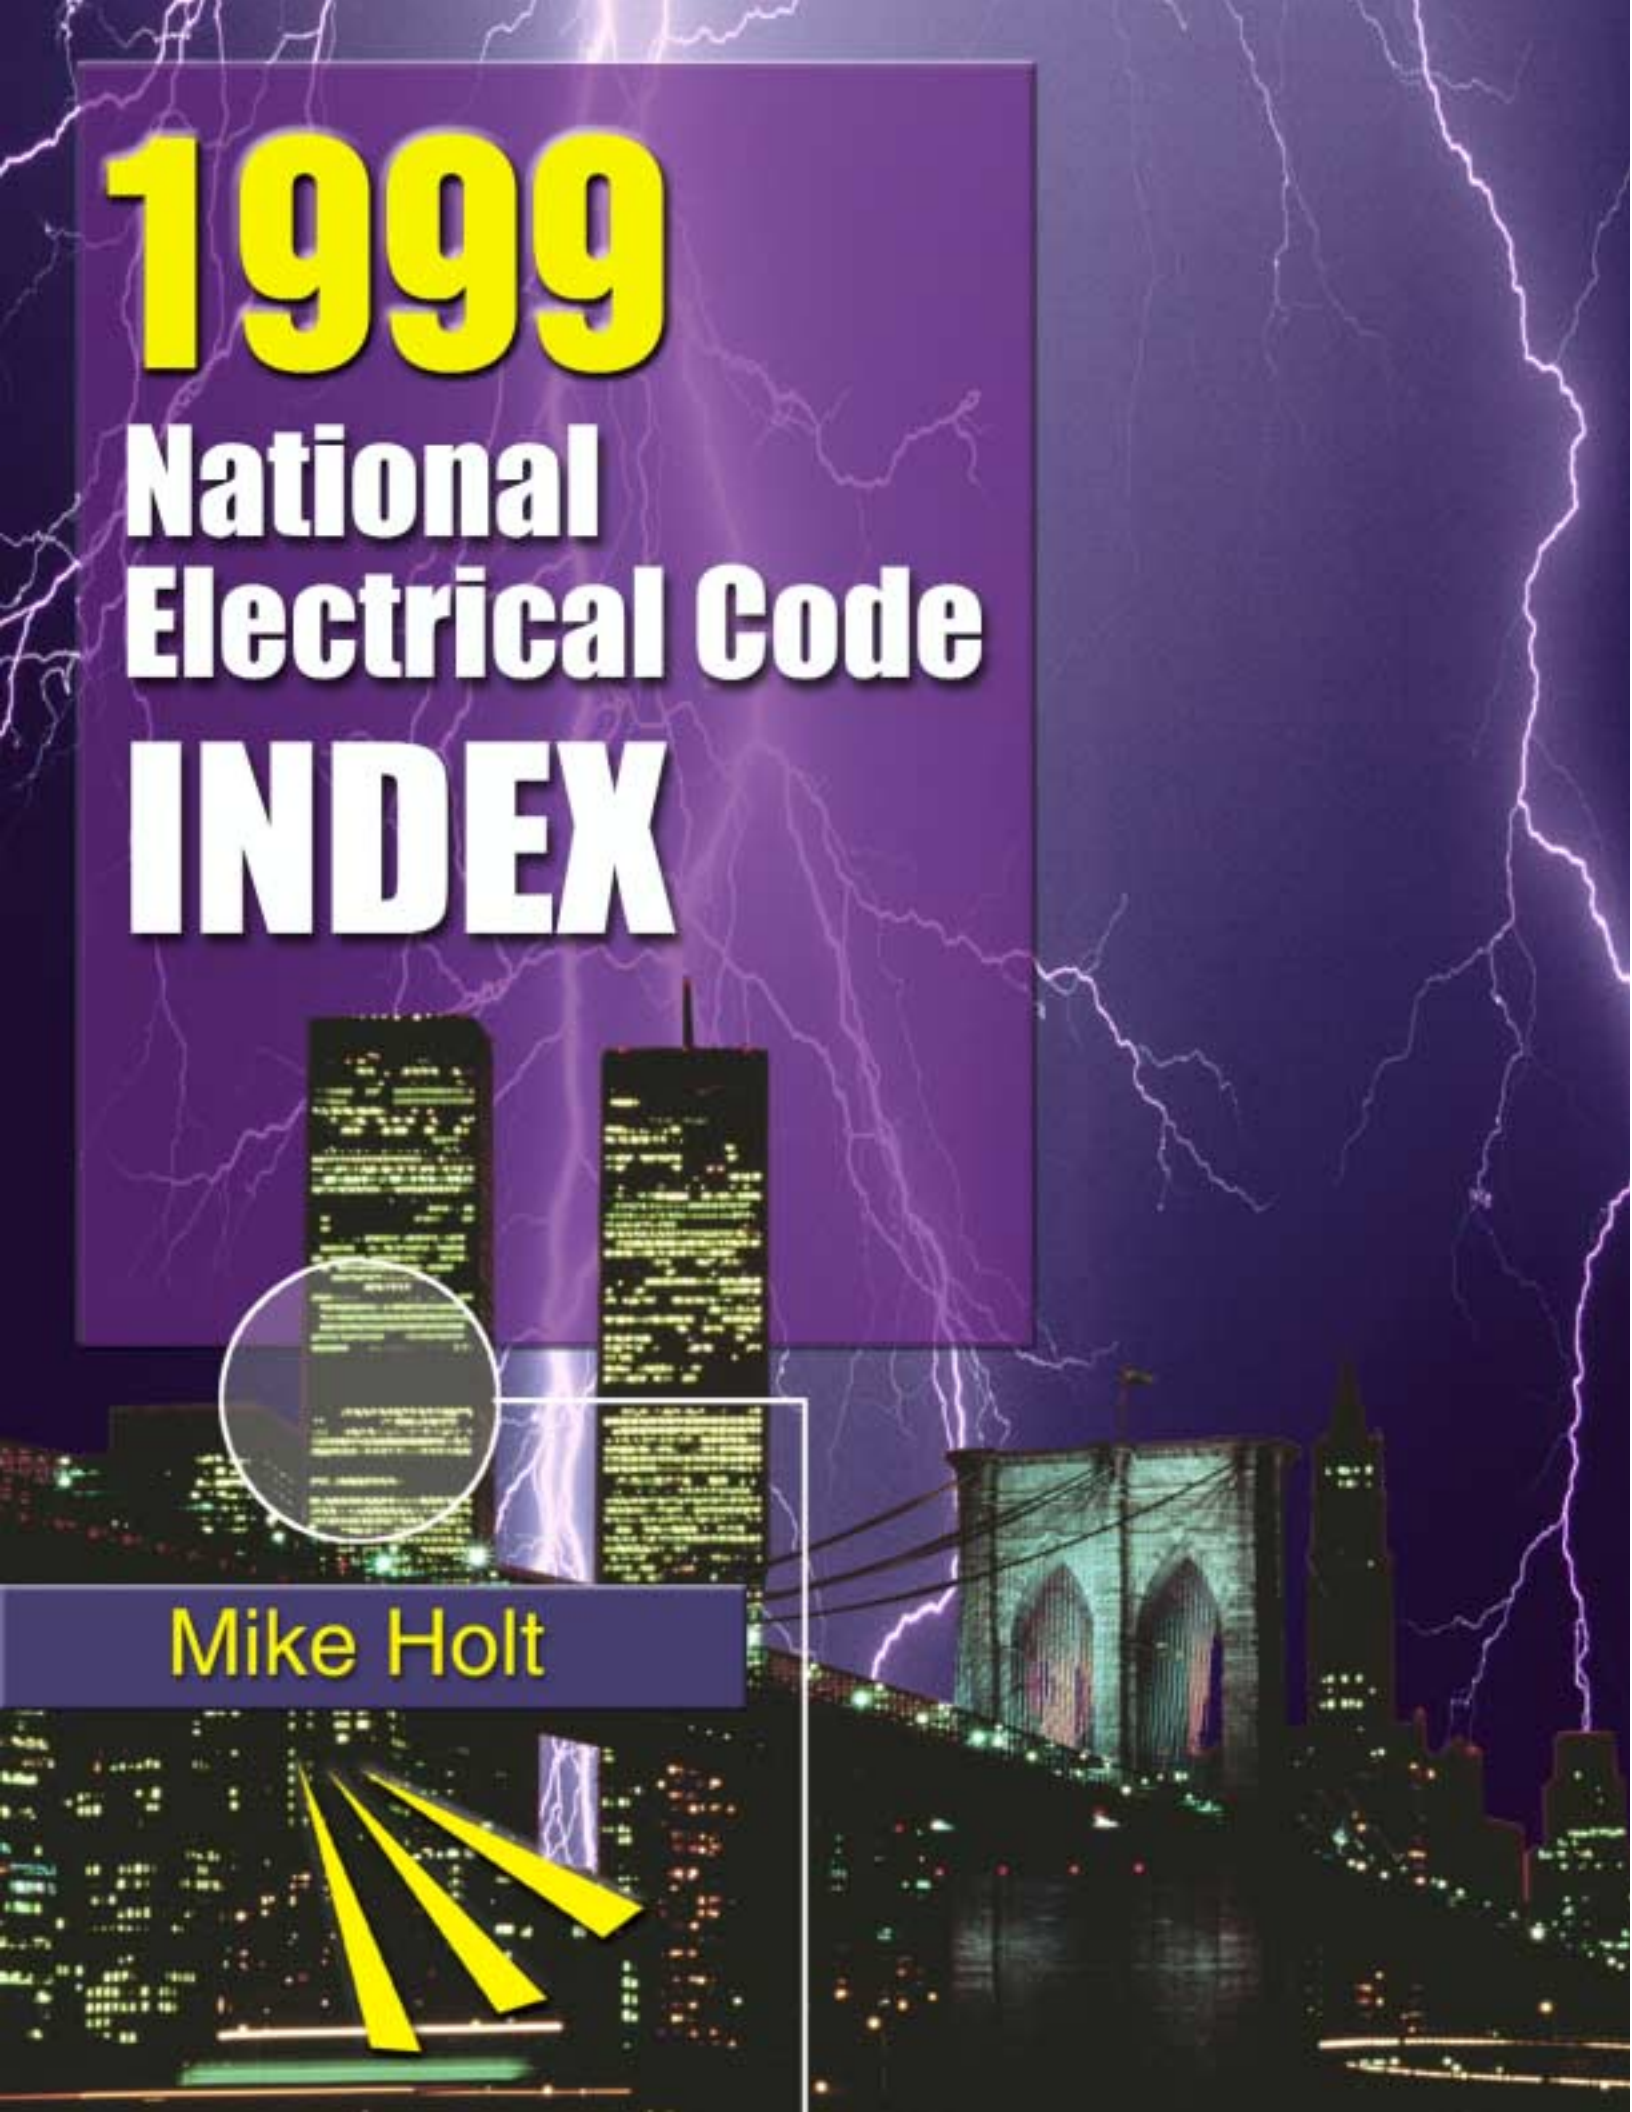


The background of the cover is a dark, stormy night sky with multiple bright purple lightning bolts. In the lower half, a city skyline is visible at night, with several skyscrapers illuminated. A large, semi-transparent purple rectangle is positioned in the upper left, containing the title text. A circular inset on the left side of the purple rectangle shows a preview of the index's contents. At the bottom left, there are three yellow diagonal lines pointing upwards.

1999

National Electrical Code INDEX

Mike Holt

Air-Conditioning, Article 440

Conductor Size	440-32
Disconnect, Readily Accessible	440-14
Protection, Maximum 175%	440-22

Antennas, Article 810

Clearances	810-18
Grounding	810-21
Grounding, Cable	810-20

Appliances, Article 424

Cords	422-16(a)(2)
Disconnects	422- Part C
Disconnect, Cord	422-23
Disconnect, Unit Switch	422-33
Dishwashers	422-16(b)(2)
Disposals	422-16(a)(1)
Paddle Fan Support, see 370-27(c)	422-18
Trash Compactor	422-16(b)(2)
Water Heaters	422-13

Armored Cable (AC), Article 333

Ampacity	333-20 Exc.
Attics and Roof Spaces	333-12
Bending Radius	333-8
Exposed Work	333-11
Framing Members (Through)	333-10
Support	333-7
Uses, Not Permitted	333-4
Uses, Permitted	333-3
Whip, Support Not Required	333-7(b)(3)

Bonding

Class I Hazardous Locations	501-16(a)
Class II Hazardous Locations	502-16(a)
Class III Hazardous Locations	503-16(a)
Enclosures	250-96
Equipment Bonding Jumpers	250-102
Gas Piping	250-104(b)
Hazardous (Classified) Locations	250-100
Lightning Protection Systems	250-106
Loosely Jointed Metal Raceways	250-98
Metal Piping	250-104(c)
Mobile/Manufactured Homes	550-11(c)
Over 250 Volts Circuits	250-97
Pool	680-22
Receptacles	250-146
Service Equipment	250-92
Service Equipment, Methods	250-94
Service Raceways	250-92
Spas and Hot Tubs, Indoors	680-41(d)
Structural Steel	250-104(d)
Transformers, see 250-104(a)(4)	250-32
Water Fountains	680-53
Water Pipe	250-104(a)

Boxes, Article 370

1/4 Inch from Finish	370-20
----------------------	--------

Access to Electrical Equipment	300-23
Accessible	370-29
Corrosion, see 370-40(a)	300-6
Covers/Plates, see 370-41, 410-12	370-25
Damp Location	370-15
Emergency Circuits	700-9(a)
Exposed Surface Extensions	370-22
Extension Rings	370-16(a)
Extension Rings, Conductor Length	370-14
Fixture Boxes	370-27(a)
Floor Boxes	370-27(b)
Floor Box, Dwelling Unit	210-52(a)(3)
Gaps or Space Around Boxes	370-21
Grounding, see 250-148	370-4
Hazardous (Class I) Locations	501-4
Hazardous (Class II) Locations	502-4
Junction Box Sizing	370-28
Manhole	370 Part D
Nonmetallic Boxes	370-3
Number of Wires	370-16
Paddle Fans	370-27(c)
Pool Light, Junction Box for	680-21
Pull and Junction Boxes	370-28(a)
Raised Floor, see 300-22(d)	645-5(d)
Spread of Fire	300-21
Support, see 370-43	370-23
Support, Suspended Ceiling	370-23(d)
Underground Splices, see 300-15(g)	300-5(e)
Unused Openings, see 110-12(a)	370-18
Volume, Cubic Inches	370-16(a) Table
Wet Location	370-15
When Required	300-15(a)

Branch Circuits, Article 210

Air Conditioning	440-32
Bathroom, 20 Ampere Circuit	210-11(c)(3)
Busway	364-8
Classification Rating	210-3
Cord Connected Equipment	210-23(a)
Electric Space Heating, 125%	424-3(b)
Emergency Power	700-18
Equipment Fastened in Place	210-23(a)
House Panel	210-25
Inductive Loads	210-22(b)
Laundry, 20 Ampere, see 220-16(b)	210-11(c)(2)
Minimum Size	210-19(d)
Motors, Sized at 125%	430-22(a)
Multiwire Branch Circuits	210-4
Overcurrent Protection	240-3
Ranges	210-19(c)
Recreational Vehicles	551-42
Refrigeration Equipment	440-32
Sign	600-5(a)
Small Appliance, see 220-16(a)	210-11(c)(1)
Taps, see 210-24	210-19(d)
Temporary Wiring	305-4(c)
Voltage Drop, Branch Circuit	210-19(a)FPN 4
Voltage Limit	210-6

Busways, Article 364


Branch Circuit, Busways	364-8
Dead Ends to Be Closed	364-7
Extension, Through Walls and Floors	364-6
Marking	364-15
Overcurrent Protection, Feeders	364-10
Overcurrent Protection, Branches	364-13
Reduction in Size	364-11
Support	364-5
Taps, Feeder or Branch Circuit	364-12
Uses	364-4

Cable Trays, Article 318

Cable Installation	318-8
Conductor Ampacity	318-11
Fill, Multiconductor Cables	318-9
Fill, Single Conductors	318-10
Grounding	318-7
Grounding	318-8
Installation Requirements	318-6
Uses	318-3 and 4

Cables

Access to Electrical Equipment	300-23
Armored Cable, Type AC	333-1
Bored Holes	300-4(a)(1)
Burial Depth	300-5(a)
Bushing, see 300-16(b), 300-4(f)	300-5(h)
Continuity, Electrical, see 300-13	300-10
Continuity, Mechanical, see 300-12	300-12
Corrosion Protection	300-6
Ducts	300-22(a)

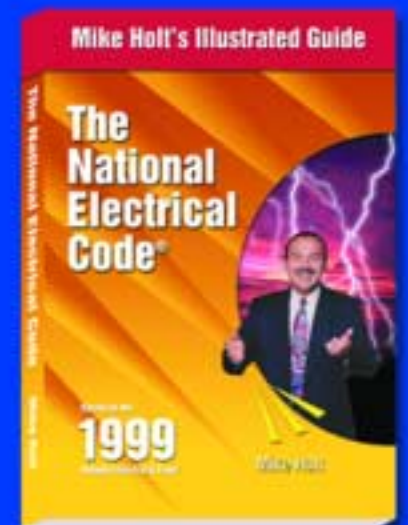

Understanding the National Electrical Code, was written to provide insight into and understanding of many of the technical rules of the NEC. Informal and relaxed in style the book contains clear graphics and examples that apply to the 1990s.

1-888 NEC CODE

Fittings, Use Only As Designed For	300-15(a)
Framing Members (Through)	300-4(d)
Habitable Rooms	300-22(c) Ex. 3
Listing, Class 2, 3, PLTC Cables	725-71
Metal-Clad Cable, Type MC	334-1
Nonmetallic-Sheathed Cable	336-1
Notching Wood	300-4(a)(2)
Protection from Nails and Screws	300-4(b)(2)
Raised Floor Wiring, see 300-22(d)	645-5(d)(5)
Service Entrance Cable (SE, USE)	338-1
Spread of Fire	300-21
Support, Suspended Ceiling	300-11(a)
Termination	373-5(c)
Type UF Cable	339-1
Under Buildings	300-5(c)

Calculations Load, Standard

Appliances, Dwelling Unit	220-17
Dryers, Dwelling Unit	220-18
Electric Space Heating	220-15
General Lighting Demand Factors	220-11
General Lighting VA Load	220-3(a)
Kitchen Equipment, Commercial	220-20
Laundry Circuit 1,500 VA	220-16(b)
Lighting Commercial, 180 VA	220-3(b)(11)
Loads Evenly Among Circuits	210-11(d)
Mobile/Manufactured Homes	550-7
Neutrals	220-22
Noncoincidental Loads	220-21
Ranges, Dwelling Unit	220-19
Receptacles, 180 VA	220-3(b)(9)
Signs, see 600-5	220-3(c)(6)
Small Appliance Circuit, 1500 VA	220-16(a)
Track Light Load	220-12(b)
Voltage, see 220-2	110-4

Calculations Load, Optional

Dwelling Units, Existing	220-35
Dwelling Units, New	220-30
Farms	220-40
Multifamily Dwelling Units	220-32
Restaurants	220-36
Schools	220-34

Carnival, Circuses, Fairs, Article 525

Disconnect	525-30
GFCI Protection	515-18
Overhead Conductor, Clearances	525-12
Splices	525-14
Wiring Methods	525-13

CATV, Article 820

Access to Electrical Equipment	820-5
Air-Handling Spaces, see 300-22(c)	820-3(b)
Entering Buildings	820-11
Fire Resistant Cables	820-49
Grounding	820-40
Installation, Cables and Equipment	820-52
Listing and Marking	820-50

Neat and Workmanlike Manner	820-6
Outside	820-10
Plenums Spaces, see 300-22(c)	820-3(b)
Spread of Fire, see 300-21	820-3(a)
Support, Building Structure	820-6

Circuit Breakers, Article 240

Back-Fed	384-16(g)
Bathrooms, Dwelling Units	240-24(e)
Clothes Closets	240-24(d)
Continuous Load, 80%	384-16(d)
Deteriorating Agents, see 110-12(c)	240-24(c) FPN
Easily Ignitable Material	240-24(d)
Handle Ties	240-20(b)
Height, 6' 7", see 240-24(a)(4)	380-8(a)
Indicating, "Open" or "Closed"	240-81
Interrupting Rating	240-83(c)
Marking	240-83
Neutral, Switched, see 514-5	380-2(b)
Occupant Access, see 230-91(b)	240-24(b)
Physical Damage, see 110-11	240-24(c)
Readily Accessible	240-24(a)
Series Rating	240-86
Slash Voltage Rating	240-85
Standard Sizes	240-6(a)
Straight Voltage Rating	240-85
Used As Switch (SWD), see 380-8(a)	240-83(d)
Vertical Position, see 240-81	240-33
Wet Locations	380-4

Class 1 Control, Article 725

Access to Electrical Equipment	725-5
Air-Handling Spaces, see 300-22(c),	725-3(b)
Circuit Requirements	725-15
Conductors	725-27
Mixing Circuits, Enclosure, Raceway	725-26
Neat and Workmanlike Manner	725-7
Overcurrent Protection	725-23
Plenum Space, see 300-22(c)	725-3(b)
Power Source Requirements	725-21
Safety-Control Equipment	725-8
Spread of Fire, see 300-21	725-3(a)
Support, Building Structure	725-7
Wiring Methods	725-25

Class 2 Control, Article 725

Access to Electrical Equipment	725-5
Air-Handling Spaces, see 300-22(c)	725-3(b)
Cable Requirements	725-61
Mixing Circuits, Enclosure, Raceway	725-54
Neat and Workmanlike Manner	725-7
Plenum Spaces, see 300-22(c)	725-3(b)
Requirements	725-15
Safety-Control Equipment	725-8
Spread of Fire, see 300-21	725-3(a)
Support, Building Structure	725-7
Wiring Methods	725-52

Class 3 Control, Article 725


Access to Electrical Equipment	725-5
Air-Handling Spaces, see 300-22(c)	725-3(b)
Cable Requirements	725-61
Mixing Circuits, Enclosure, Raceway	725-54
Neat and Workmanlike Manner	725-7
Plenum Spaces, see 300-22(c)	725-3(b)
Power Sources	725-41
Requirements	725-15
Safety-Control Equipment	725-8
Spread of Fire, see 300-21	725-3(a)
Support, Building Structure	725-7
Wiring Methods	725-52

Computer Rooms, Article 645

Cables Beyond Computer Room	645-6
Connecting Cables, see 645-5(c)	645-5(b)
Disconnects	645-10
Fire Boundaries, see 300-21	645-7
Raised Floor Wiring, see 300-22(d)	645-5(d)(5)
Uninterruptible Power Supplies	645-11

Conductors, Article 310

6 Inches Free	300-14
Air-Conditioning, Size	440-32
Ampacity, Continuous Load	210-19(a)
Area, Square Inch	Chap 9, Table 5
Bare Conductors	Chap 9, Table 8
Bushings	300-4(f)
Color Code	310-12
Color Code Not Required	210-5
Compact Aluminum	Chap 9, Tbl 5(a)

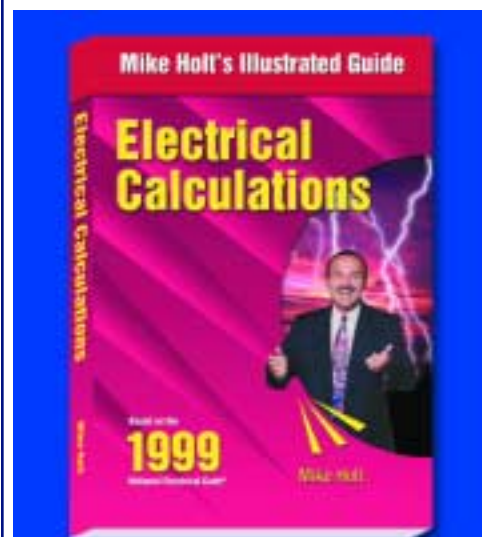

Electrical Calculations must be mastered to become successful in the electrical trade. You must understand how to perform important the electrical calculations specified in the National Electrical Code. Our books and videos programs are designed to remove the intimidation to the following calculations:

1-888 NEC CODE

Conductors Continued, Article 310

Conductor Fill	370-17
Copper Unless Otherwise Identified	110-5
Corrosive Conditions	310-9
Current Carrying	310-15(b)
Derating, Above 86°F	310-16 Table
Derating, Conductor Bundling	310-15(b)(2)
Dwelling Units, 120/240 Volt	310-15(b)(6)
Electric Space Heating, 125%	424-3(b)
Generators, see 240-21(g)	445-5
Grouping Conductors, see 300-5(i)	300-3(b)
High-Leg, see 230-56 and 384-3(e)	215-8
Insulation Specifications	310-13 Table
Minimum Size	310-5
Motors, 125%	430-22(a)
Motors, Feeder Size	430-24
Neutrals, White or Natural Gray	200-6
Nipple, see 310-15(b)(2) Exc. 3	Chap 9, Table 1
Overcurrent Protection	240-3
Parallel Requirements	310-4
Pigtails	300-13(b)
Resistance, see Chapter 9, Table 9	Chap 9, Table 8
Signs	600-5(a)
Size, Terminal Rating	110-14(c)
Specifications	310-13 Table
Splices Not Permitted In Raceways	300-13(a)
Splices, General Requirements	110-14(b)
Support, Vertical Raceways	300-19
Temperature Limit, see 110-14(c)	310-10
Terminals Rated 60°C	110-14(c)(1)
Terminals Rated 75°C	110-14(c)(2)
Terminals, Torque	110-14 FPN
Terminations	110-14(a)
Underground Splices, 300-15(b)	300-5(e)

Conduit Body

Conductor Fill	370-16(c)
Splices, Permitted	370-16(c)

Cooking Equipment

Demand Factor, see 210-19	220-19
Disconnects	422-32
Exhaust Fan Wiring, see 300-22(a)	410-4(c)
Receptacles, Rating	210-21(b)(4)
Tap Conductors	210-19(c) Ex. 1

Cords, Article 400

Ampacity	400-5
Cord Connected Equipment, 80%	210-23(a)
Disconnect, Appliances	422-22
Grounding Conductor Identification	400-23
Lighting Fixtures, see 410-31(c)	410-30
Neutrals, Flexible Cords	400-22
Overcurrent Protection, see 240-4	400-13
Pool Equipment	680-7
Protection against Physical Damage	400-14
Specifications	400-4 Table
Splices	400-9
Strain Relief at Terminals	400-10
Temporary Wiring	305-4
Uses, Not Permitted	400-8
Uses, Permitted	400-7

Disconnecting Means

A/C and Refrigeration Equipment	440-14
Air-Conditioning, In Sight	440-14
Capacitors	460-8(c)
Computer/Data Processing Rooms	645-10
Cord, Appliance	422-32
Duct Heaters	424-65
Electric Space Heating (Part C)	424-19 Thru 22
Gasoline Dispensers	514-5
Hot Tubs, Outdoors	680-12
Identification	110-22
Marina Shore Power Receptacles	555-4
Mobile Homes, see 550-23	550-6
Motors	430-102(b)
Motor Control Circuits	430-74
Motor Controllers	430-102(a)
Pools	680-12
Refrigeration, In Sight	440-14
Separate Buildings or Structures	225 Part B
Services	230-70 Thru 82
Signs	600-6
Spas, Outdoor	680-12
Temporary Wiring	305-4(e)

Electric Heat, Article 424

Baseboard Heaters	424-9
Conductor Size, 125%	424-3(b)
Disconnects	424-19
Disconnect, Duct Heaters	424-65

Overcurrent Protection, 125%	424-3(b)
Receptacles, Baseboard Heater	424-9
Thermostats, Not Disconnect	424-20(b)

Electrical Metallic Tubing, Article 348

Bends, How Made	348-11
Bends, Number in One Run	348-12
Bushings	300-4(f)
Couplings and Connectors	348-10
Reaming and Threading	348-9
Size, 1/2 to 4 Inch	348-7
Supports	348-13
Uses, Not Permitted	348-5
Uses, Permitted	348-4
Wet Locations	348-6

Elect. Nonmetallic Tubing, Article 331


Bending Radius	331-9
Bends, Number in One Run	331-10
Concrete Installations	331-3(6)
Direct Earth Burial	331-4(5)
Joints, PVC Fitting Okay	331-8
Prewired Assemblies	331-3(8)
Size, 1/2 to 2 Inch	331-5
Supports	331-11
Uses, Not Permitted	331-4
Uses, Permitted	331-3

Emergency Systems, Article 700

Audible and Visual Signal Devices	700-7
Battery Packs (Unit Equipment)	700-12(e)
Branch Circuit	700-18
Capacity and Rating	700-5(a)
Generators	700-12(b)
Ground-Fault Protection of Equipment	700-26
Grounding Electrode Conductors	700-8(b)
Identification, Enclosures/Equipment	700-9(a)
Lighting Requirements	700-16
Load on Emergency Branch Circuits	700-15
Overcurrent Protection, Accessible	700-25
Separate Services	700-12(d)
Signs	700-8
Storage Batteries	700-12(a)
Test and Maintenance	700-4
Transfer Switch Equipment	700-6
Uninterruptible Power Supplies	700-12(c)
Wiring, Kept Independent	700-9(b)

Equipment

1/4 Inch Air Space	300-6(c)
Cleaning and Lubricating Compounds	110-11 FPN 2
Cooling, see 450-9	110-13(b)
Dedicated Equipment Space	110-26(f)
Deteriorating Agents	110-11
Deteriorating Temperatures	110-11
Identification, Circuits	110-22
Installation to Listing Instructions	110-3(b)
Interrupting Rating	110-9
Manufacturer's Markings	110-21

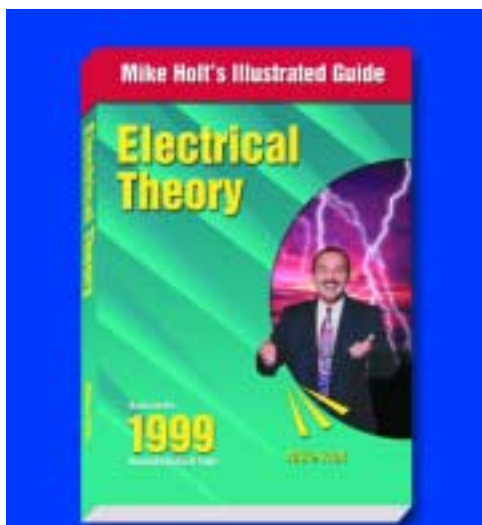

Electrical Theory concepts is the foundation for all in the electrical industry.

1-888 NEC CODE

Mounting With Wood Plugs	110-13(a)
Neat and Workmanlike Manner	110-12
Protection Against Physical Damage	110-27(b)
Protection, Internal Parts	110-12(c)
Series Rating, see 240-86	110-22
Short-Circuit Current Ratings	110-10
Short-Circuits and Ground-Faults	110-7
Testing Laboratories	90-7
Unused Openings, see 373-4, 370-18	110-12(a)
Warning Signs – Exposed Live Parts	110-27(c)
Working Space, Access	110-26
Working Space, Clearance	110-26(a)
Working Space, Entrance	110-26(c)
Working Space, Headroom	110-26(e)
Working Space Illumination	110-26(d)
Working Space, No Storage	110-26(b)

Feeders, Article 215

10 Foot Taps	240-21(b)(1)
25 Foot Taps	240-21(b)(2)
Dwelling Units, Size, see 310-15(b)	215-2(c)
Ground-Fault Protection (GFPE)	215-10
Grounding, see 384-20	215-6
High-Leg, see 230-56 and 384-3(e)	215-8
Outside Buildings	225-32
Outside, Unlimited Length	240-21(b)(5)
Over 25 Foot Tap, High Bay Buildings	240-21(b)(4)
Overcurrent Protection	215-3
Size, Continuous Load, see 215-3	215-2(a)
Voltage Drop	215-2(d) FPN 2

Fire Alarm (NPL) Article 760, Part B

Access to Electrical Equipment	760-5
Air-Handling Spaces, see 300-22(c)	760-3(b)
Conductors	760-27
Extending Beyond One Building	760-7
Identification	760-10
Listing and Marking	760-31
Mixing Circuits, Enclosure, Raceway	760-26
Multiconductor Cables	760-30
Neat and Workmanlike Manner	760-8
Number of Conductors	760-28
Overcurrent Protection	760-23
Plenum Spaces, see 300-22(c)	760-3(b)
Spread of Fire, see 300-21	760-3(a)
Support, By Building Structure	760-8
Wiring Methods	760-25

Fire Alarm (PL) Article 760, Part C

Access to Electrical Equipment	760-5
Air-Handling Spaces, see 300-22(c)	760-3(b)
Extending Beyond One Building	760-7
Identification	760-10
Listing and Marking Cables	760-71
Mixing Circuits, Enclosure, Raceway	760-54
Neat and Workmanlike Manner	760-8
Plenum Spaces, see 300-22(c)	760-3(b)
Power Sources	760-41

Spread of Fire, see 300-21	760-3(a)
Support, By Building Structure	760-8
Wiring Methods	760-52

Fire Pumps, Article 695

Conductor Size, 125%	695-6(c)
Continuity of Power	695-4
Control Wiring	695-14
Power Sources	695-3
Service Conductors	695-6(a)
Transformers	695-5
Voltage Drop Requirement	695-7

Fixture Wire, Article 402

Ampacity	402-5
Conduit or Tubing, Appendix C	402-7
Minimum Size, 18 AWG	402-6
Neutral, Identification	402-8
Overcurrent Protection	402-12
Specifications	402-3 Table
Tap Conductors	410-67(c)
Uses, Not Permitted	402-11
Uses, Permitted	402-10

Flexible Metal Conduit, Article 350

Bends	350-16
Conductor Fill	350-12
Fittings	350-20
Grounding	350-14
Sizes	350-10
Supports	350-18
Trimming	350-22
Uses, Not Permitted	350-5
Uses, Permitted	350-4

Fountains, Article 680

Bonding	680-53
General	680-50
GFCI Protection	680-56(a)
Grounding Methods	680-54
Junction Boxes	680-52

Fuses, Article 240

Bathrooms, Dwelling Unit	240-24(e)
Cartridge Fuses	240-60
Clothes Closets	240-24(d)
Continuous Load, 80%	384-16(d)
Current Limiting	240-11
Easily Ignitable Material	240-24(d)
Edison Base Fuse	240-51(a)
Interrupting Rating	240-60(c)(3)
Physical Damage, see 110-11	240-24(c)
Readily Accessible	240-24(a)
Standard Ratings	240-6(a)
Supplementary Fuses	240-10
Type S Fuses	240-53

Garages, Repair, Storage, Article 511

Charging Equipment, see Article 525	511-9
-------------------------------------	-------

Class I, Division 1 Locations	511-3(b)
Class I, Division 2 Locations	511-3(b)
Classification, see 511-3	511-2
Equipment above Hazard Location	511-7
Fuel Dispensing Unit Inside Building	511-3(e)
GFCI Protection, Receptacle	511-10
Portable Lighting Equipment	511-3(f)
Seal-offs	511-5
Wiring Above Hazardous Location	511-6
Wiring Methods	511-4

Gasoline Dispensers, Article 514


Disconnect, All Circuit Conductors	514-5
Grounding	514-16
Seal-offs, see 501-5	514-7
Underground Wiring	514-8
Wiring	514-3
Wiring Above Hazardous Location	514-4

GFCI Protection, General

Hydromassage Bathtub	680-70
Light Fixtures, Pool Area	680-6(b)(2)
Light Fixtures, Spa/Hot Tub Indoor	680-41(b)
Light Fixtures, Spa/Hot Tub Outdoor	680-6(b)(2)
Pool Lights	680-20(a)(1)
Signs, Portable or Mobile	600-10
Spa and Hot Tubs, Indoor	680-41(a)(3)
Spa and Hot Tubs, Outdoor	680-42

GFCI Protection, Receptacles

Accessory Buildings, Dwelling Unit	210-8(a)(2)
Agricultural Buildings	547-9(c)
Basements, Dwelling-Unit	210-8(a)(5)
Bathrooms, Commercial	210-8(b)(1)

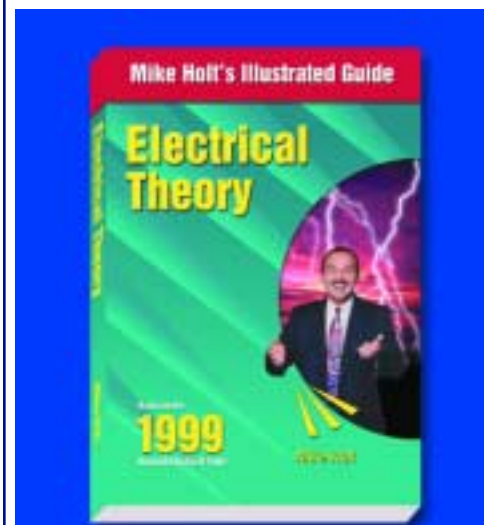

Electrical Theory concepts is the foundation for all in the electrical industry.

1-888 NEC CODE

GFCI Protection Continued

Bathrooms, Dwelling Unit	210-8(a)(1)
Carnivals, Circuses, and Fairs	525-18
Commercial Garages	511-10
Crawl Space, Dwelling Unit	210-8(a)(4)
Elevator Pits	620-85
Garages, Dwelling Unit	210-8(a)(2)
Health Care Facilities, see 517-21	517-20(a)
Kitchen Countertop, Dwelling Unit	210-8(a)(6)
Marinas	555-3
Mobile/Manufactured Home	550-8(b)
Outdoor, Dwelling Unit	210-8(a)(3)
Replacement	210-7(d)
Rooftop, Commercial	210-8(b)(2)
Swimming Pool Area	680-6(a)(1), (3)
Temporary Power	305-6
Wet Bar, Dwelling Unit	210-8(a)(7)

Grounding, Article 250

Clean Surfaces, see 250-96	250-12
Earth, Sole Path, see 250-2(d)	250-54
Effectively Grounded	250-136
Main Bonding Jumper	250-28
Neutral-to-Ground Connections	250-142
Purpose of Grounding	250-2

Grounding Conductor, Article 250

Color	250-119
Continuity	250-124
Installation	250-120
Isolated Ground Receptacle	250-146(d)
Objectionable Current	250-6
Sizes	250-122
Terminations	250-8, 130
Types	250-118

Grounding Electrode, Article 250

Bonding Electrodes Together	250-58
Earth, Sole Path, see 250-2(d)	250-54



Grounding Electrode System	250-50
Lightning Protection, see 250-106	250-60
Made Electrode Resistance	250-56
Made Electrode Types	250-52
Supplementary Grounding Electrodes	250-54

Ground Electrode Cond., Article 250

Emergency Power Systems	700-8(b)
Installation	250-64
Legal Required Power Systems	701-9(b)
Material, see 250-64	250-62
Size	250-66
Splice	250-64(c)
Standby Power Systems	702-7(a)
Termination, Accessible See 250-8	250-68
Termination To Electrode	250-70
Termination, Physical Damage	250-10

Grounding of Equipment, Article 250

Antenna Mast	810-15
Appliances	250-112
Boxes	250-148
Cable Trays	318-7
CATV Cable	220-33
Clothes Dryers	250-140
Cord Connected Equipment	250-138
Enclosures	250-86
Equipment Fastened in Place	250-134
Feeders, see 250-126 and 410-58	215-6
Flexible Metal Conduit	350-14
Generators	250-30
Generators, Portable	250-34(a)
Generators, Vehicle-Mounted	250-34(b)
Hazardous (Class I) Location	501-16
Hazardous (Class II) Location	502-16
Hazardous (Class III) Location	503-16
Lighting Protection Equipment	250-106
Lightning Arrester	280-25
Liquidtight Metal Conduit	351-9
Marinas and Boatyards	555-8
Mobile/Manufactured Homes	550-11
Network-Powered Broadband Cable	830-40
Optical Fiber, Entrance Cable	770-33
Panelboards	384-20
Pools, see 680-25 and 680-41	680-24
Raceways	250-86
Ranges	250-140
Receptacles, General	250-146
Receptacles, Patient Care Areas	517-13(a)
Satellite Dish Masts	810-15
Separate Buildings or Structures	250-32
Services	250-24
Short Sections of Raceways	250-132
Spray Paint Booth Equipment	516-16
Switches, Patient Care Areas	517-13(a)
Switches, see 517-13(a) Exc. 3	380-12
Systems	250-20
Telephone Cable	810-21

Transformers	250-30
Underground Service Cable	250-84

Grounding of Services, Article 250

Bonding Jumper, Size	250-66
Enclosures	250-80
Main Bonding Jumper	250-28
Raceways	250-80

Harmonics and Nonlinear Loads

Cords	400-5
Multiwire Branch Circuits	210-4(a) FPN
Neutral, Current Carrying	310-15(b)(4)(c)
Neutral, see 220-22 FPN No. 2	220-22
Transformer Heat	450-3 FPN 2
Transformer Heat	450-9 FPN 2

Hazardous Class I, Article 501

Alarms	501-14
Attachment Plugs	501-12
Bonding Requirements	501-16(a)
Circuit Breakers	501-6
Class I Group Classifications	500-5(a)
Class I, Division 1, Description	500-7(a)
Class I, Division 2, Description	500-7(b)
Class and Properties	500-5(c)
Cords	501-11
Equipment	501-10
Fuses	501-6
Generators	501-8
Grounding	501-16
Lighting Fixtures	501-9
Motors	501-8
Multiwire Branch Circuits	501-18
Receptacles	501-12
Remote-Control Circuits	501-14
Seal-offs	501-5
Signaling Circuits	501-14
Switches	501-6
Wiring Methods	501-4

Hazardous Class II, Article 502

Alarms	502-14
Attachment Plugs	502-13
Bonding	502-16(a)
Circuit Breakers	502-6
Class II Group Classifications	500-5(b)
Class II, Division 1, Description	500-8(a)
Class II, Division 2, Description	500-8(b)
Cords	502-12
Dust-Ignitionproof, Definition	502-1
Equipment	502-10
Fuses	502-6
Generators	502-8
Grounding	502-16
Lighting Fixtures	502-11
Motors	502-8
Multiwire Branch Circuits	502-18
Receptacle	502-13


Remote-Control Circuits	502-14
Seal-Offs	502-5
Signaling Circuits	502-14
Switches	502-6
Wiring Methods	502-4

Hazardous Class III, Article 503

Alarms	503-12
Attachment Plugs	503-11
Bonding	503-16(a)
Circuit Breakers	503-4
Class III, Division 1, Description	500-9(a)
Class III, Division 2, Description	500-9(b)
Cords	503-10
Equipment	503-8
Fuses	503-4
Generators	503-6
Grounding	503-16
Lighting Fixtures	503-9
Motors	503-6
Motor Controllers	503-4
Receptacles	503-11
Remote-Control Circuits	503-12
Signaling Circuits	503-12
Switches	503-4
Wiring Methods	503-3

Hazardous Zone, Article 550

Bonding	505-25
Equipment	505-20
Engineer Supervised	505-6(a)
General Requirements	505-3
Grounding	505-25
Group Classification	505-7
Listing and Marking, Documentation	505-10
Locations	505-3
Reference Standards	505-5

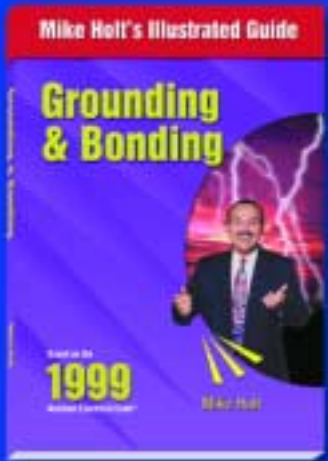

Surveys repeatedly show 90% of power quality problems are due to poor grounding and bonding. Get a handle on some serious issues in your facility.

1-888 NEC CODE

Temperatures	505-8
Zone Classifications	505-9

Health Care Facilities, Article 517

Isolated Ground Receptacles	517-16
Receptacles, Hospital Grade	517-18, 19
Receptacles, Patient Care Area	517-13(a)
Switches, Patient Care Areas	517-13(a)
Veterinary Facilities, Not Applicable	517-1 FPN 1

High-Leg

Feeders	215-8
Panels and Switchboards	384-3(e)
Services	230-56
Phase Arrangement	384-3(f)

Inspector's Responsibilities

Approval of Equipment, see 90-4	110-2
Code Enforcement	90-4
Interpretation of Rules	90-4

IMC, Article 345

Aluminum Fittings	345-3(a) Exc.
Bends, How Made	345-10
Bends, Number in One Run	345-11
Bushings	345-15
Corrosion Protection	345-3(b)
Couplings and Connectors	345-9
Dissimilar Metals	343-3
Reaming and Threading	345-8
Running Threads	345-9(b)
Size, 1/2 to 4 Inches	345-6
Supports	345-12
Uses	345-3
Wet Locations	345-5

Intrinsically Safe, Article 504

Bonding	504-60
Equipment Approval	504-4
Equipment Installation	504-10
Grounding	504-50
Identification	504-80
Sealing	504-70
Separation from Other Circuits	504-30
Wiring Methods	504-20

Legal Standby Systems, Article 701

Ahead of Service Disconnect	701-11(e)
Audible and Visual Signal Devices	701-8
Battery Packs (Unit Equipment)	701-11(f)
Capacity and Rating	701-6
Definitions	701-2
Generators	701-11(b)
Grounding Electrode Conductor	701-9(b)
Separate Service	701-11(d)
Signs	701-9
Storage Batteries	701-11(a)
Test and Maintenance	701-5
Transfer Switch Equipment	701-7

Uninterruptible Power Supplies	701-11(c)
Wiring	701-10

Lighting Fixtures, Article 410

Bathtub and Shower Space	410-4(d)
Clothes Closets	410-8
Combustible Material, see 410-68	410-65
Conductors	410-24
Cooking Hoods, see 300-22(a)	410-4(c)
Cords, see 410-14 and 410-30	410-30(c)
Corrosion	410-4(b)
Cove Lighting	410-9
Cover, see 370-25	410-12
Damp Locations	410-4(a)
Discharge Lighting Fixtures	410-14
Emergency Lighting Requirements	700-16
Hazardous (Class I) Locations	501-9
Hazardous (Class II) Locations	502-11
Hazardous (Class III) Locations	503-9
Metal Poles	410-15(b)
Not Exceeding 277 Volts	225-7(c)
Paddle Fan, see 410-4(d)	422-18
Pendant Lampholders	410-27(a)
Pools, GFCI Protection	680-6(b)(2)
Pools, Storage	680-32
Raceways, Used As	410-31
Receptacle Adapters, Not Permitted	410-47
Required, Commercial	210-70(c)
Required, Dwelling Units	210-70(a)
Spas and Hot Tubs, Indoor, GFCI	680-41(b)
Support, Boxes	410-16(a)
Support, Paddle Fans, see 370-27(c)	422-18
Support, Suspended Ceiling Support	410-16(c)
Support, Trees Okay	410-16(h)
Taps Conductor, see Table 220-24	210-19(d) Ex. 1
Temperature Limitation of Conductors	410-11
Track Lighting	410-101 - 104
Used for Raceway	410-31
Wet Locations	410-4(a)

Liquidtight Conduit, Article 351

Bends, see 351-30	351-10
Conductor Fill, see 351-25	351-6
Fitting, see 351-26	351-7
Grounding, see 351-28	351-9
Size, see 351-24	351-5
Supports	351-8
Use, see 351-23	351-4(a)

Marinas and Boatyards, Article 555

Disconnect, Receptacles	555-4
Gasoline Dispensers	555-10
Grounding	555-8
Receptacles, GFCI Protection	555-3
Service Calculations	555-6
Service Equipment, Location	555-11
Wiring Methods	555-7

Metal-Clad Cable (MC), Article 334

Ampacity	334-13
Bending Radius	334-11

Metal-Clad Cable Continued

Fittings	334-12
Fixture Whips, Support Not Required	334-10(b)
Supports	334-10(a)
Uses, Not Permitted	334-4
Uses, Permitted	334-3

Mobile/Manufactured, Article 550

Appliance Terminal Connections	550-10(j)
Attachment Plugs	550-5(c)
Bonding	550-11(c)
Branch Circuit Calculations	550-7
Disconnect, see 550-23	550-6
Feeder Conductors	550-24
Feeder to Home	550-5(a)
GFCI Requirements	550-8(b)
Grounding	550-11
Handle-Ties	550-6(c)
Metal Faceplates, Grounded	550-10(d)
Nameplates	550-6(d)
Neutral, Insulated	550-11(a)
Overcurrent Protection	550-6(b)
Panelboards, Not In Bathrooms	550-6(a)
Park Demand Factors	550-22
Park Distribution Centers	550-21
Power Supplies	550-5
Raceways, Requirements	550-10(f)
Ranges and Clothes Dryers	550-10(e)
Receptacles, Outdoors	550-15
Receptacles, Requirements for	550-8
Service Equipment	550-23
Service/Feeder Calculations	550-13
Wiring Methods	550-10
Working Space	550-6(a)

**Motors, Article 430**

Branch Circuit Protection	430-52 and 152
Conductor Size, With Other Loads	430-25
Controllers, Enclosure Types	430-91
Controllers, Not Open All Conductors	430-84
Controllers, One for Each Motor	430-87
Disconnects, All Conductors	430-103
Disconnects, Control Circuits	430-74
Disconnects, Each Motor	430-112
Disconnects, Location	430-102
Disconnects, Marked "Off or On"	430-104
Disconnects, Readily Accessible	430-107
Disconnects, Types	430-109
Feeder, Conductor Size	430-24
Feeder, Short-Circuit Protection	430-61 and 62
FLC Instead of Nameplate Current	430-6(a)
FLC, DC Motors	430-147 Table
FLC, Single-Phase	430-148 Table
FLC, Three-Phase	430-150 Table
Location, Motors	430-14
Locked-Rotor Current	430-151 Table
Orderly Shutdown	430-44
Overload, Fuses	430-36
Tap Conductors	430-28

Network Broadband, Article 830

Access to Electrical Equipment	830-6
Air-Handling Spaces, see 300-22(c)	820-3(b)
Bends	830-57
Entering Buildings	830-11
Entrance Cables	830-9
Equipment and Cables	830-5
Grounding Cables	830-40
Installation, Cables and Equipment	830-58
Mixing Circuits, Enclosure, Raceway	830-58(a)
Neat and Workmanlike Manner	830-7
Plenum Spaces, see 300-22(c)	820-3(b)
Power Limitations	830-4
Protection against Physical Damage	830-56
Spread of Fire, see 300-21	830-3(a)
Support, By Building Structure	830-7
Wiring Methods	830-54

Neutral Conductor, Article 200

Cooking Units	210-19(c)
Current Carrying	310-15(b)(4)
Feeder/Service Calculations	220-22
Fixture Wires, Identification	402-8
Flexible Cords	400-22
Identification of Different Systems	200-6(d)
Mobile/Manufactured Homes	550-11(a)
Multiwire Branch Circuits	210-4(c)
Nonlinear loads, see 210-4(a)	220-22 FPN 2
Pigtails, Device Removal	300-13(b)
Polarity	200-11
Screw Shell Termination	200-10(c)
Switched, see 514-5(a)	380-2(b)
White or Natural Gray	200-6

Nonmetallic Cable, Article 336

Ampacity, Based On 60°C	336-26
Attics and Roof Spaces, see 333-12	336-6(d)
Basements	336-6(c)
Bending Radius	336-16
Exposed	336-6
Framing Members (Through)	336-9
Supports	336-18
Uses, Not Permitted	336-5
Uses, Permitted	336-4

Optical Fiber Cable, Article 770

Access to Electrical Equipment	725-7
Air-Handling Spaces, see 300-22(c)	770-3(b)
Cable Types	770-5
Grounding, Entrance Cables	770-33
Installation	770-52
Listed Cables and Raceways	770-51
Neat and Workmanlike Manner	725-7
Plenums Spaces, see 300-22(c)	770-3(b)
Raceway Systems	770-6
Spread of Fire, see 300-21	770-3(a)
Support, By Building Structure	725-8

Optional Standby Power, Article 702

Audible and Visual Signal Devices	702-7
Capacity and Rating	702-5
Definitions	702-2
Grounding Electrode Conductor	702-8(b)
Signs	702-8
Transfer Switch Equipment	702-6

Outside Wiring, Article 225

Clearance from Building Openings	225-19
Clearance from Ground	225-18
Festoon Lighting, see 225-13	225-6(b)
Lighting, Not Exceeding 277 Volts	225-7(c)
Overhead Conductors, Size	225-6(a)
Point of Attachment, see 230-26	225-16
Raceway, Raintight/Arranged to Drain	225-22
Trees Not Permitted for Support	225-26
Wiring Methods	225-10

Overcurrent Protection, Article 240

Bathrooms, Dwelling Unit	240-24(e)
Capacitors	460-25
Circuits Rated 800 Amperes or Less	240-3(b)
Circuits Rated Over 800 Amperes	240-3(c)
Conductors	240-3
Continuous Load, 80%	384-16(d)
Cords, see 240-4	400-13
Current Limiting	240-11
Deteriorating Agents, see 110-12(c)	240-24(c) FPN
Easily Ignitable Material	240-24(d)
Electric Space Heating, 125%	424-3(b)
Emergency Circuits, Accessible	700-25
Feeders	215-3
Fixture Wires, see 402-12	240-4(b)(2)

Flexible Cords, see 400-13	240-4(b)(1)
Ground-Fault Protection of Equipment	240-13
Mobile/Manufactured Homes	550-6(b)
Motor Branch Circuits	430-52
Motor Control Circuits	430-72
Occupant Access, see 230-91(b)	240-24(b)
Physical Damage, see 110-11	240-24(c)
Readily Accessible	240-24(a)
Service Conductors, see 230-91	230-90
Standard Sizes	240-6(a)
Supplementary Protection	240-10
Tap Conductors, see 240-21	240-3(e)

Panel Cabinets, Article 373

1/4 Inch Air Space	373-3
Damp Location	373-2
Hazardous (Classified) Locations	373-2
Splices and Taps, Permitted	373-8
Unused Openings	373-4
Use As Junction Boxes, Permitted	373-8
Wet Locations	373-2
Wire Bending Space At Terminal	373-6(a) Table

Panelboard, Article 384

Back-Fed, Circuit Breakers	384-16(g)
Continuous Load, 80%	384-16(d)
Delta Breakers Not Permitted	384-16(f)
Grounding	384-20
High Leg, Marking	384-3(e)
Identification of Circuits	384-13
Number Overcurrent Devices	384-15
Overcurrent Protection	384-16
Phase Arrangement	384-3(f)
Sprinkler Protection, see 110-26(f)	384-4
Transformer Supplied	384-16(e)

Places of Assembly, Article 518

Occupancy Types	518-2
Temporary Wiring	518-3(b)
Wiring Methods	518-4

Plenum Cable

Coaxial Cables	820-51(a)
Control and Signaling (Class 2 and 3)	725-61(a)
Fire Alarm Cables	760-61(a)
Network Powered Systems	830-54(a)
Optical Fiber Cables	770-53(a)
Sound System Cables	640-9(c)
Telecommunications Cables	800-53(a)

Raceways General, Article 300

1/4 Inch Air Space	300-6(c)
Access to Electrical Equipment	300-23
Area Square Inch	Chapter 9, Table 4
Back Fill	300-5(f)
Bored Holes	300-4(a)(1)
Burial Depth	300-5(a)
Bushings	300-4(f)
Complete Before Installing	300-18(a)

Continuity, Mechanical	300-12
Continuity, see 300-12 and 300-13	300-10
Corrosion Protection	300-6
Ducts	300-22(a)
Emergency Circuits, Independent	700-9
Expansion Joints, see 250-98, 347-9	300-7(b)
Exposed to Different Temperatures	300-7(a)
Fittings, Use Only Designed	300-15(a)
Fixtures, Used for Raceway	410-31
Guys and Braces for Service Mast	230-28
Habitable Rooms	300-22(c) Ex. 3
Hysteresis, Induced Heating	300-20
Nipples, Note 4	Chap 9, Table 1
Notching Wood	300-4(a)(2)
Number of Conductors, Appendix C	300-17
Other Systems In Raceway	300-8
Raised Floors, see 645-5(d)	300-22(d)
Service Mast	230-28
Splices Not Permitted In Raceway	300-13(a)
Spread of Fire	300-21
Support, Suspended Ceiling	300-11(a)
Suspended Ceiling Space	300-22(c)
Underground	300-5

Receptacles

Appliances, Within 6 Feet	210-50(c)
Arc-Fault Circuit Interrupters (AFCI)	210-12
Attics, Required Within 25 Feet	210-63
Baseboard Heaters	424-9
Basement, Dwelling-Units	210-52(g)
Bathroom, Dwelling-Units	210-52(d)
Carnivals, Circuses, and Fairs	525-18
CO/ALR	410-56(b)
Commercial Load Demand Factor	220-13
Covers	410-56(d)
Damp Locations	410-57(a)
Face-Up Position, 210-52(d)	210-52(c)(5)
Flat Conductor Cable (Type FCC)	328-14
Garages, Required, Dwelling Unit	210-52(g)
Grounding, see 250-146	210-7
Hallways, Dwelling Unit	210-52(h)
Hazardous (Class I) Locations	501-12
Hazardous (Class II) Locations	502-13
Hazardous (Class III) Locations	503-11
Hospital Grade, see 517-19	517-18
Hot Tubs, 5' from Indoor Spas	680-41(a)(1)
Isolated Ground, Health Care	517-16
Isolated Ground, see 250-146(d)	410-56(c)
Kitchen Countertops Required	210-52(c)
Laundry, Dwelling Units	210-52(f)
Marinas and Boatyards, GFCI	555-3
Mobile/Manufactured Home	550-8
Multioutlet, Branch Circuit Ampacity	210-19(b)
Multioutlet, Receptacle, Load	210-21(b)(2)
Multioutlet, Receptacle, Ratings	210-21(b)(3)
Non-Grounding Type, Replacement	210-7(d)
Outdoor, Dwelling Units	210-52(e)
Patient Care Areas, Grounding	517-13(a)


Pendant Cord	210-50(a)
Placement, Dwelling Units	210-52(a)
Raised Covers, Two Screws Required	410-56(f)(3)
Receptacle Adapters Not Permitted	410-47
Rooftop Equipment	210-63
Shore Power, Marinas and Boatyards	555-3
Show Windows	210-62
Single Rated 100%	210-21(b)(1)
Small Appliance Circuits	210-52(b)(2)
Swimming Pools, GFCI	680-6
Temporary Power, see 305-6 GFCI	305-4(d)
Wet Locations	410-57(b)

Refrigeration, Article 440

Conductor Sizes	440-32
Disconnect, In Sight	440-14
Protection, 175%	440-22

Rigid Metal Conduit, Article 346

Aluminum Fittings	346-3(a)
Bends, How Made	346-10
Bends, Number in One Run	346-11
Bushings, see 300-4(f)	346-15
Corrosion Protection	346-3(b)
Couplings and Connectors	346-9
Dissimilar Metals	346-3(a)
Reaming and Threading	346-8
Running Threads	346-9(b)
Size, 1/2 - 6 Inch	346-6
Supports	346-12
Uses	346-3
Wet Locations	346-5

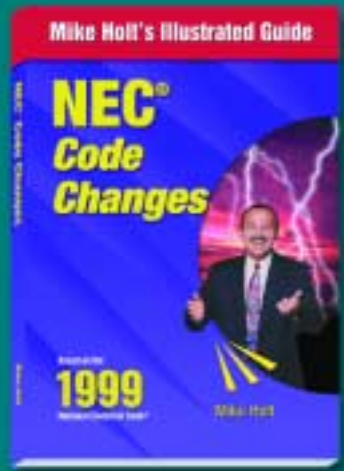

Mike Holt's Illustrated Guide
NEC® Code Changes
1999
Mike Holt

NEC Code Changes was written to help you understand the vast number of changes proposed by the NEC. This book explains the change and its effects on you and the electrical industry. The text translates the changes into everyday easy to understand language.

1-888 NEC CODE

Rigid Nonmetallic, Article 347

Bends, How Made	347-13
Bends, Number in One Run	347-14
Bushings, see 300-4(f)	347-12
Expansion Characteristics	347-9
Extreme Cold	347-2 FPN
Joints, How Made	347-6
Size, 1/2 to 4 Inches	347-10
Support	347-8
Trimming	347-5
Uses, Not Permitted	347-3
Uses, Permitted	347-2

Satellite Dish, Article 810


Clearances	810-18
Grounding Method	810-21
Grounding, Cable	810-20
Grounding, Masts	810-15

Service Cable (SE, USE), Article 338

Branch Circuit or Feeder Use	338-3
Exterior Installations	338-4(b)
Interior Installations	338-4(a)

Service Conductors, Article 230,

Clearance from Building Openings	230-9
Clearance from Ground	230-24
Clearance over Buildings	230-29
Clearance over Pools, 680-8	230-24(d)
Conductors, Outside Building	230-6
Drip Loops	230-54(f)
High Leg, Identification	230-56
Numbers Permitted	230-2
Overcurrent Protection, see 230-91	230-90
Point of Attachment	230-26
Pools, Clearance, see 230-24(d)	680-8
Raceway, Arranged to Drain	230-53

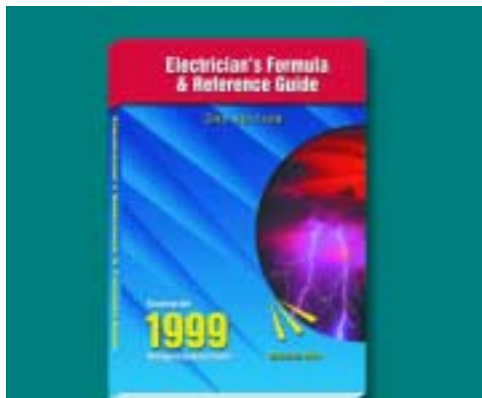

This guide will help you perform electrical calculations as they apply to any and all electrical installations under 600 volts. This includes residential, commercial and industrial buildings. It contains warnings of dangers related to improper electrical installations, and offers many helpful suggestions and tips.

1-888 NEC CODE

Sealing, Raceways	230-8
Separation from Other Conductors	230-7
Service Cables	230-50(a)
Service Entrance Conductors	230-40
Service Heads (Weatherhead)	230-54
Service Laterals	230-31
Service Masts, Support	230-28
Splices	230-46
Through Another Building	230-3
Underground, see 230-49 and 300-5	230-32
Voltage Drop	230-31(c) FPN
Wiring Methods	230-43

Service Disconnect, Article 230

Access to Occupants	230-72(c)
Combined Rating	230-80
Equipment on the Supply Side	230-82
Fire Pump/Emergency Systems	230-72(b)
Grouping	230-72(a)
Indicating, "Open" or "Closed"	230-77
Location	230-70(a)
Marking	230-70(b)
Maximum of Six	230-71(a)
Rating	230-79
Suitable for Service Equipment	230-66

Signs, Outline Lighting, Article 600

Branch Circuits	600-5
Disconnects	600-6
Listing	600-3
Markings	600-4
Neon, Over 1000 Volts	600-32
Vehicle Clearances	600-9(a)

Sound Systems, Article 640

Access to Electrical Equipment	640-5
Conduit or Tubing	640-23
Fire Partitions, Walls, and Ceilings	640-25
Grounding	640-7
Grouping of Conductors	640-8
Neat and Workmanlike Manner	640-6
Protection of Electrical Equipment	640-4
Wiring Methods	640-9

Spas, Hot Tubs, Indoors, Article 680

Bonding	680-41(d)
Grounding	680-41(f)
Lighting Fixtures, GFCI Indoors	680-41(b)
Lighting Fixtures, Indoors	680-41(b)
Paddle Fans, Locations Indoors	680-41(b)
Receptacles, Indoors	680-41(a)
Switches, Minimum 5' Away	680-41(c)
Underwater Audio Equipment	680-41(i)
Water Heaters	680-41(h)

Spas, Hot Tubs, Outdoors Article 680

Bonding	680-22
Cord Connected Equipment	680-7
Covers	680-26

Deck Area Heating	680-27
Deck Heating	680-27
Disconnect, Within Sight	680-12
Dry-Niche Lighting Fixtures	680-20(c)
GFCI Protection	680-5(c)
GFCI Protection	680-42
Grounding, Motors	680-25(c)
Grounding, Panelboards	680-25(d)
Grounding, Pool Light Fixtures	680-25(b)
Grounding, Pool Sub-panel	680-25(d)
Heaters	680-9
Lighting	680-20(a)
Lighting, 18 Inches Under Water	680-20(a)(3)
Lighting, Junction Box	680-21
Lighting, Listed Potting Compound	680-20(b)(1)
Lighting, Separate from Other Wires	680-5(c)
Lighting, Transformer	680-5(a)
Lighting, GFCI Protection	680-6(b)(2)
Lighting, Minimum 5 Feet from Pool	680-6(b)
No-Niche Light	680-20(d)
Overhead Conductor, Clearances	680-8
Paddle Fan, Location	680-6(b)
Receptacles, 10 Feet from Pool	680-6(a)
Receptacles, GFCI Protection	680-6(a)(3)
Receptacles, Minimum 5' from Water	680-6(c)
Receptacles, Within 20 Feet of Pool	680-6(a)(2)
Switches, Minimum 5' from Water	680-6(c)
Underground Wiring	680-10
Underwater Audio Equipment	680-23(a)
Wet-Niche Lighting Fixtures	680-20(b)

Splices

Accessible	370-29
Box Not Required, Construction Site	305-4(g)
Boxes, When Required	300-15(a)
Conduit Bodies	370-16(c)
Cords	400-9
Dissimilar Metals	110-14
General Provisions	110-14(b)
Panelboard Cabinet	373-8
Raceway, Not Permitted In	300-13(a)
Service	230-46
Underground, see 300-15(g)	300-5(e)

Spray Paint Booths, Article 516

Class I, Division 1 Descriptions	516-2(a)
Class I, Division 2 Descriptions	516-2(b)
Classification, Locations	516-2
Equipment, Class I Locations	516-3(b)
Grounding, see 501-16	516-16
Illumination	516-3(c)
Signs, Requirements	516-4(h)
Wiring Above Class I, II Locations	516-7
Wiring Methods, Class I Locations	516-3(a)

Surface Raceway, Article 352

Conductor Fill, see 352-25	352-4
Conductor Size, see 352-24	352-3

Grounding	352-9
Separate Chambers, see 352-26	352-6
Splices and Taps, see 352-29	352-7
Use, see 352-22	352-1
Walls and Floors, see 352-28	352-5

Surge Arresters, Article 280

Grounding	280-25
Installation, Load Side of Service	280-22
Installation, Location	280-11
Installation, Service	280-21
Routing of Conductors	280-12

Swimming Pools, Article 680

Bonding	680-22
Cord Connected Equipment	680-7
Deck Area Heating	680-27
Definitions	680-4
Dry-Niche Lighting Fixtures	680-20(c)
GFCI Protection, Receptacle	680-6(a)(3)
GFCI Protection, Wiring	680-5(c)
Grounding, Motors	680-25(c)
Grounding, Panelboards	680-25(d)
Grounding, Pool Light Fixtures	680-25(b)
Grounding, Pool Sub-panel	680-25(d)
Lighting, 5 Feet from Pool	680-6(b)
Lighting, GFCI Protection	680-6(b)(2)
No-Niche Lighting	680-20(d)
Overhead Conductor, Clearances	680-8
Paddle Fans, Location	680-6(b)
Pool Lights 15 Volts or Less	680-20(a)(1)
Pool Lights 18 Inches Under Water	680-20(a)(3)
Pool Lights GFCI	680-20(a)(1)
Pool Lights Junction Box	680-21
Pool Lights Listed Potting Compound	680-20(b)(1)
Pool Lights No 8 Insulated	680-20(b)(1)
Pool Lights Transformer	680-5(a)
Pool Lights, Wiring Separate	680-5(c)
Pool, Covers	680-26
Pool, Deck Heating	680-27
Pool, Heaters	680-9
Receptacles, 10 Feet from Pool	680-6(a)
Receptacles, 5' from Pool Water	680-6(c)
Receptacles, GFCI	680-6(a)(3)
Receptacles, Within 20 Feet of Pool	680-6(a)(2)
Service Conductor Clearance	230-24(d)
Switches, Minimum 5' from Water	680-6(c)
Transformers	680-5
Underground Wiring	680-10
Underwater Audio Equipment	680-23(a)
Wet-Niche Lighting Fixtures	680-20(b)

Swimming Pools, Storable Article 680

GFCI Protection	680-31
Lighting Fixtures, Requirements	680-32
Motors, Requirements	680-30

Switchboards, Article 384

Dedicated Space, see 110-26(f)	384-4
High Leg, Marking	384-3(e)
Phase Arrangement	384-3(f)
Sprinkler Protection, see 110-26(f)	384-4

Switches, Article 380

3-Way and 4-Way, see 200-7(c)(2)	380-2(a)
5' Pools, Spas/Hot Tubs Outdoors	680-6(c)
Accessible	380-8
Busways, Permitted Above 6 Feet	380-8(a) Exc. 1
Circuit Breakers, see 380-11	380-8(a)
CO/ALR	380-14(c)
Fixture Canopy	410-38(c)
Grounding	380-12
Indicating, "Open" or "Closed"	380-7
Knife Switches	380-6(c)
Neutrals, Not Switched	380-2(b)
Not Permitted in Bathtub/Shower	380-4
Readily Accessible, see 240-24(a)	380-8(a)
Voltage Between Adjacent Switches	380-8(b)
Wet Locations	380-4

Telephone, Article 800

Access to Electrical Equipment	800-5
Circuits Entering Buildings	800-11
Communications Raceway System	800-48
Fire Resistance of Cables	800-49
Grounding Cable	800-33
Grounding Method	800-40
Installation	800-52
Lightning, Conductors	800-13
Listed Cables and Raceways	800-51
Overhead Wires and Cables	800-10

Temporary Wiring, Article 305

Boxes Not Required, see 300-5(e)	305-4(g)
Branch Circuit Requirements	305-4(c)
Disconnects	305-4(e)
Feeder Requirements	305-4(b)
Lamp Protection	305-4(f)
Physical Protection, Cables	305-4(h)
Receptacles, GFCI Protection	305-6
Receptacles, Requirements	305-4(d)
Removal Upon Completion	305-3(d)
Time Constraints	305-3

Transformer Vaults, Article 450

Doors	450-43
Location	450-41
Ventilation Openings	450-45
Walls, Roof, and Floor	450-42

Transformers, Article 450

Autotransformer, see 450-4	210-9
Combustible Material	450-21(a)
Cooling, see 110-13(b)	450-9
Overcurrent Protection	450-3(b)


Readily Accessible	450-13
Secondary Conductors, 10 Feet	240-21(c)(2)
Secondary Conductors, 25 Feet	240-21(c)(3)
Secondary Conductors Outdoors	240-21(c)(4)
Suspended Ceiling Space	450-13(b)
Swimming Pools	680-5
Ventilation	450-9

Voltage Drop

Branch Circuits	210-19(a) FPN 4
Conductors	310-15 FPN
Feeder	215-2(d) FPN 2
Fire Pump Motors	695-7
Grounding Conductors	250-122
Services	230-31(c) FPN

Wireways, Article 362

Conductor Fill, see 362-19	362-5
Conductor Size, see 362-18	362-4
Ends to Be Closed, see 362-25	362-10
Expansion Joints	362-23
Extensions, see 362-26	362-11
Size, see 362-20	362-6
Splices/Taps, see 362-21	362-7
Support, see 362-22	362-8
Through Walls, see 362-24	362-9
Use, see 362-15 and 362-16	362-2

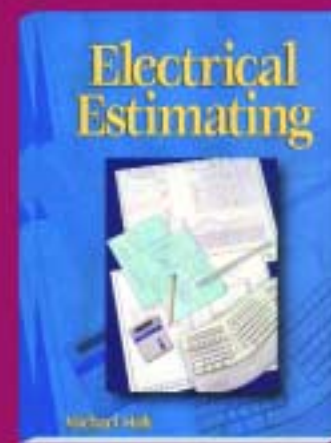

Running a business requires an understanding of how to estimate a job. This program will show you how to take-off a job, determine the material cost and how to accurately estimate the labor cost. You'll learn the importance of knowing how to determine your overhead, profit and break-even point. This course gives tips on selling and marketing your business.

1-888 NEC CODE