



Mike Holt's

USEFUL & PRACTICAL 2023 NEC[®] INDEX

NEC[®], NFPA 70[®], NFPA 70E[®] and National Electrical Code[®] are registered trademarks of the National Fire Protection Association



This copyright document is not permitted to be shared without written permission from Mike Holt Enterprises. Contact info@mikeholt.com



Mike Holt Enterprises
MikeHolt.com • 888.632.2633

BASED ON THE
**2023
NEC[®]**

NOTICE TO THE READER

The publisher does not warrant or guarantee any of the products described herein or perform any independent analysis in connection with any of the product information contained herein. The publisher does not assume, and expressly disclaims, any obligation to obtain and include information other than that provided to it by the manufacturer.

The reader is expressly warned to consider and adopt all safety precautions that might be indicated by the activities herein and to avoid all potential hazards. By following the instructions contained herein, the reader willingly assumes all risks in connection with such instructions.

The publisher makes no representation or warranties of any kind, including but not limited to, the warranties of fitness for particular purpose or merchantability, nor are any such representations implied with respect to the material set forth herein, and the publisher takes no responsibility with respect to such material. The publisher shall not be liable for any special, consequential, or exemplary damages resulting, in whole or part, from the reader's use of, or reliance upon, this material.

Author: Mike Holt

Technical Illustrator: Mike Culbreath

COPYRIGHT © 2023 Charles Michael Holt



Produced and Printed in the USA

All rights reserved. No part of this work covered by the copyright hereon may be reproduced or used in any form or by any means graphic, electronic, or mechanical, including photocopying, recording, taping, or information storage and retrieval systems without the written permission of the publisher. You can request permission to use material from this text by either calling 888.632.2633, e-mailing Info@MikeHolt.com, or visiting www.MikeHolt.com.

For more information, call 888.632.2633, or e-mail Info@MikeHolt.com.


NEC®, NFPA 70®, NFPA 70E® and National Electrical Code® are registered trademarks of the National Fire Protection Association.



This logo is a registered trademark of Mike Holt Enterprises, Inc.

ABOUT THE AUTHOR

Mike Holt is an author, businessman, educator, speaker, publisher and *NEC*® expert. He's written hundreds of electrical training books and articles, founded three successful businesses, and has taught thousands of electrical *Code* seminars across the U.S. and internationally.

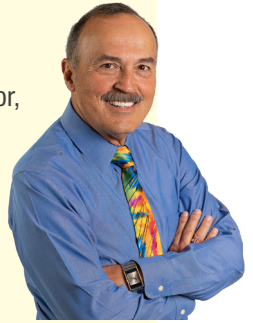

Mike's approach to electrical training is based on his own experience as an electrician, contractor, inspector and teacher. He's always felt a responsibility to his students and to the electrical industry to provide education beyond the scope of just passing an exam. This commitment, coupled with the lessons he learned at the University of Miami's MBA program, have helped him build one of the largest electrical training and publishing companies in the United States. His one-of-a-kind presentation style and his ability to simplify and clarify technical concepts explain his unique position as one of the premier educators and *Code* experts in the country. His passion for the electrical field drives his goal to increase electrical safety and improve lives.

Mike's commitment to pushing boundaries and setting high standards extends into his personal life. He's an eight-time Overall National Barefoot Waterski Champion with more than 20 gold medals, many national records, and he has competed in three World Barefoot Tournaments. In 2015, at the tender age of 64, he started a new adventure—competitive mountain bike racing. Every day he continues to find ways to motivate himself, both mentally and physically.

Mike and his wife, Linda, reside in New Mexico and Florida, and are the parents of seven children and six grandchildren. As his life has changed over the years, a few things have remained constant: his commitment to God, his love for his family, and doing what he can to change the lives of others through his products and seminars.

*I dedicate this product to the
Lord Jesus Christ,
my mentor and teacher.
Proverbs 16:3*



Release Date: September 15, 2023


MIKE HOLT'S 2023 *NEC* INDEX

Introduction

This index is a free resource from Mike Holt Enterprises. It was designed to help you find what you're looking for in the *Code* book in seconds! This index lists difficult key words and gives you the section where these words appear in the *National Electrical Code*®. It's a great tool to get you familiar with those hard to find references in the *NEC*®. Use this index along with your *Code* book and tabs (below) and you'll be in great shape!


2023 *Code* Book

Need to order a *Code* book? The most widely adopted element of a building code in the United States and the world, the *NEC*, is the benchmark for safe and efficient electrical installations. Whether your jurisdiction adopts the 2023 *Code* immediately or down the road, you need to extend your knowledge and take advantage of the benefits right away, not months or years behind your peers in the electrical industry.



2023 Tabs

Peel-and-stick Tabs are a great way to customize your *Code* book, but too many tabs defeat the purpose. Mike Holt's adhesive tabs allow you to mark and reference important articles and tables quickly, making it easier for you to use the *NEC*. They are compatible with the 2023 *Code Book and Handbook*, and can even be used on Mike's Holt's *Understanding the National Electrical Code Volumes 1 and 2* which have color-coded chapters to match the colors of the tabs.

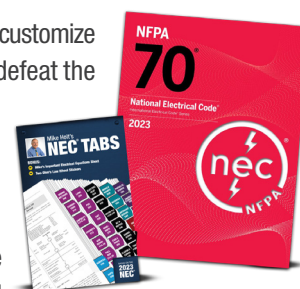

Included in the set are 96 tabs, including 7 blanks, a 16 in. x 20 in. Raceway and Wire Sizing Poster, and 2 Ohms Wheel Stickers.

For more on this and other products, visit www.MikeHolt.com/Code, or call 888.632.2633.



HOW TO USE THE *NATIONAL ELECTRICAL CODE*

The original *NEC* document was developed in 1897 as a result of the united efforts of various insurance, electrical, architectural, and other cooperative interests. The National Fire Protection Association (NFPA) has sponsored the *National Electrical Code* since 1911.

The purpose of the *Code* is the practical safeguarding of persons and property from hazards arising from the use of electricity. It isn't intended as a design specification or an instruction manual for untrained persons. It is, in fact, a standard that contains the minimum requirements for an electrical installation that's essentially free from hazard. Learning to understand and use the *Code* is critical to you working safely; whether you're training to become an electrician, or are already an electrician, electrical contractor, inspector, engineer, designer, or instructor.

The *NEC* was written for qualified persons; those who understand electrical terms, theory, safety procedures, and electrical trade practices. Learning to use the *Code* is a lengthy process and can be frustrating if you don't approach it the right way. First, you'll need to understand electrical theory and if you don't have theory as a background when you get into the *NEC*, you're going to struggle. Take one step back if necessary and learn electrical theory. You must also understand the concepts and terms in the *Code* and know grammar and punctuation in order to understand the complex structure of the rules and their intended purpose(s). The *NEC* is written in a formal outline which many of us haven't seen or used since high school or college so it's important for you to pay particular attention to this format. Our goal for the next few pages is to give you some guidelines and suggestions on using your *Code* book to help you understand that standard, and assist you in what you're trying to accomplish and, ultimately, your personal success as an electrical professional!

Language Considerations for the *NEC*

Terms and Concepts

The *NEC* contains many technical terms, and it's crucial for *Code* users to understand their meanings and applications. If you don't understand a term used in a rule, it will be impossible to properly apply the *NEC* requirement. Article 100 defines those that are used generally in two or more articles throughout the *Code*; for example, the term "Dwelling Unit" is found in many articles. If you don't know the *NEC* definition for a "dwelling unit" you can't properly identify its *Code* requirements. Another example worth mentioning is the term "Outlet." For many people it has always meant a receptacle—not so in the *NEC*!

Article 100 contains the definitions of terms used throughout the *Code*. Where a definition is unique to a specific article, the article number is indicated at the end of the definition in parenthesis (xxx). For example, the definition of "Pool" is specific to Article 680 and ends with (680) because it applies ONLY to that article. Definitions of standard terms,

such as volt, voltage drop, ampere, impedance, and resistance are not contained in Article 100. If the *NEC* does not define a term, then a dictionary or building code acceptable to the authority having jurisdiction should be consulted.

Small Words, Grammar, and Punctuation

Technical words aren't the only ones that require close attention. Even simple words can make a big difference to the application of a rule. Is there a comma? Does it use "or," "and," "other than," "greater than," or "smaller than"? The word "or" can imply alternate choices for wiring methods. A word like "or" gives us choices while the word "and" can mean an additional requirement must be met.

An example of the important role small words play in the *NEC* is found in 110.26(C)(2), where it says equipment containing overcurrent, switching, "or" control devices that are 1,200A or more "and" over 6 ft wide require a means of egress at each end of the working space. In this section, the word "or" clarifies that equipment containing any of the three types of devices listed must follow this rule. The word

“and” clarifies that 110.26(C)(2) only applies if the equipment is both 1,200A or more and over 6 ft wide.

Grammar and punctuation play an important role in establishing the meaning of a rule. The location of a comma can dramatically change the requirement of a rule such as in 250.28(A), where it says a main bonding jumper shall be a wire, bus, screw, or similar suitable conductor. If the comma between “bus” and “screw” was removed, only a “bus screw” could be used. That comma makes a big change in the requirements of the rule.

Slang Terms or Technical Jargon

Trade-related professionals in different areas of the country often use local “slang” terms that aren’t shared by all. This can make it difficult to communicate if it isn’t clear what the meaning of those slang terms are. Use the proper terms by finding out what their definitions and applications are before you use them. For example, the term “pigtail” is often used to describe the short piece of conductor used to connect a device to a splice, but a “pigtail” is also used for a rubberized light socket with pre-terminated conductors. Although the term is the same, the meaning is very different and could cause confusion. The words “splice” and “tap” are examples of terms often interchanged in the field but are two entirely different things! The uniformity and consistency of the terminology used in the *Code*, makes it so everyone says and means the same thing regardless of geographical location.

NEC Style and Layout

It’s important to understand the structure and writing style of the *Code* if you want to use it effectively. The *National Electrical Code* is organized using twelve major components.

1. Table of Contents
2. Chapters—Chapters 1 through 9 (major categories)
3. Articles—Chapter subdivisions that cover specific subjects
4. Parts—Divisions used to organize article subject matter
5. Sections—Divisions used to further organize article subject matter
6. Tables and Figures—Represent the mandatory requirements of a rule
7. Exceptions—Alternatives to the main *Code* rule
8. Informational Notes—Explanatory material for a specific rule (not a requirement)
9. Tables—Applicable as referenced in the *NEC*
10. Annexes—Additional explanatory information such as tables and references (not a requirement)

11. Index
12. Changes to the *Code* from the previous edition

1. Table of Contents. The Table of Contents displays the layout of the chapters, articles, and parts as well as the page numbers. It’s an excellent resource and should be referred to periodically to observe the interrelationship of the various *NEC* components. When attempting to locate the rules for a specific situation, knowledgeable *Code* users often go first to the Table of Contents to quickly find the specific *NEC* rule that applies.

2. Chapters. There are nine chapters, each of which is divided into articles. The articles fall into one of four groupings: General Requirements (Chapters 1 through 4), Specific Requirements (Chapters 5 through 7), Communications Systems (Chapter 8), and Tables (Chapter 9).

- Chapter 1—General
- Chapter 2—Wiring and Protection
- Chapter 3—Wiring Methods and Materials
- Chapter 4—Equipment for General Use
- Chapter 5—Special Occupancies
- Chapter 6—Special Equipment
- Chapter 7—Special Conditions
- Chapter 8—Communications Systems (Telephone, Data, Satellite, Cable TV, and Broadband)
- Chapter 9—Tables—Conductor and Raceway Specifications

3. Articles. The *NEC* contains approximately 160 articles, each of which covers a specific subject. It begins with Article 90, the introduction to the *Code* which contains the purpose of the *NEC*, what is covered and isn’t covered, along with how the *Code* is arranged. It also gives information on enforcement, how mandatory and permissive rules are written, and how explanatory material is included. Article 90 also includes information on formal interpretations, examination of equipment for safety, wiring planning, and information about formatting units of measurement. Here are some other examples of articles you’ll find in the *NEC*:

- Article 110—General Requirements for Electrical Installations
- Article 250—Grounding and Bonding
- Article 300—General Requirements for Wiring Methods and Materials
- Article 430—Motors, Motor Circuits, and Motor Controllers
- Article 500—Hazardous (Classified) Locations
- Article 680—Swimming Pools, Fountains, and Similar Installations
- Article 725—Class 2 and Class 3 Power-Limited Circuits
- Article 800—General Requirements for Communications Systems

4. Parts. Larger articles are subdivided into parts. Because the parts of a *Code* article aren't included in the section numbers, we tend to forget to what "part" an *NEC* rule is relating. For example, Table 110.34(A) contains working space clearances for electrical equipment. If we aren't careful, we might think this table applies to all electrical installations, but Table 110.34(A) is in Part III, which only contains requirements for "Over 1,000 Volts, Nominal" installations. The rules for working clearances for electrical equipment for systems 1,000V, nominal, or less are contained in Table 110.26(A)(1), which is in Part II—1,000 Volts, Nominal, or Less.

5. Sections. Each *NEC* rule is called a "*Code* Section." A *Code* section may be broken down into subdivisions; first level subdivision will be in parentheses like (A), (B),..., the next will be second level subdivisions in parentheses like (1), (2),..., and third level subdivisions in lowercase letters such as (a), (b), and so on.

For example, the rule requiring all receptacles in a dwelling unit bathroom to be GFCI protected is contained in Section 210.8(A)(1) which is in Chapter 2, Article 210, Section 8, first level subdivision (A), and second level subdivision (1).

Note: According to the *NEC Style Manual*, first and second level subdivisions are required to have titles. A title for a third level subdivision is permitted but not required.

Many in the industry incorrectly use the term "Article" when referring to a *Code* section. For example, they say "Article 210.8," when they should say "Section 210.8." Section numbers in this textbook are shown without the word "Section," unless they're at the beginning of a sentence. For example, Section 210.8(A) is shown as simply 210.8(A).

6. Tables and Figures. Many *NEC* requirements are contained within tables, which are lists of *Code* rules placed in a systematic arrangement. The titles of the tables are extremely important; you must read them carefully in order to understand the contents, applications, and limitations of each one. Notes are often provided in or below a table; be sure to read them as well since they're also part of the requirement. For example, Note 1 for Table 300.5(A) explains how to measure the cover when burying cables and raceways and Note 5 explains what to do if solid rock is encountered.

7. Exceptions. Exceptions are *NEC* requirements or permissions that provide an alternative method to a specific rule. There are two types of exceptions—mandatory and permissive. When a rule has several exceptions, those exceptions with mandatory requirements are listed before the permissive exceptions.

Mandatory Exceptions. A mandatory exception uses the words "shall" or "shall not." The word "shall" in an exception means that if you're using the exception, you're required to do it in a specific way. The phrase "shall not" means it isn't permitted.

Permissive Exceptions. A permissive exception uses words such as "shall be permitted," which means it's acceptable (but not mandatory) to do it in this way.

8. Informational Notes. An Informational Note contains explanatory material intended to clarify a rule or give assistance, but it isn't a *Code* requirement.

9. Tables. Chapter 9 consists of tables applicable as referenced in the *NEC*. They're used to calculate raceway sizing, conductor fill, the radius of raceway bends, and conductor voltage drop.

10. Informative Annexes. Annexes aren't a part of the *Code* requirements and are included for informational purposes only.

- Annex A. Product Safety Standards
- Annex B. Application Information for Ampacity Calculation
- Annex C. Conduit, Tubing, and Cable Tray Fill Tables for Conductors and Fixture Wires of the Same Size
- Annex D. Examples
- Annex E. Types of Construction
- Annex F. Availability and Reliability for Critical Operations Power Systems (COPS), and Development and Implementation of Functional Performance Tests (FPTs) for Critical Operations Power Systems
- Annex G. Supervisory Control and Data Acquisition (SCADA)
- Annex H. Administration and Enforcement
- Annex I. Recommended Tightening Torque Tables from UL Standard 486A-486B
- Annex J. ADA Standards for Accessible Design
- Annex K. Use of Medical Electrical Equipment in Dwellings and Residential Board-and-Care Occupancies

11. Index. The Index at the back of the *NEC* is helpful in locating a specific rule using pertinent keywords to assist in your search.

12. Changes to the *Code*. Changes in the *NEC* are indicated as follows:

- ▶ Rules that were changed since the previous edition are identified by shading the revised text.
- ▶ New rules aren't shaded like a change, instead they have a shaded "N" in the margin to the left of the section number.
- ▶ Relocated rules are treated like new rules with a shaded "N" in the left margin by the section number.

- ▶ Deleted rules are indicated by a bullet symbol “•” located in the left margin where the rule was in the previous edition. Unlike older editions the bullet symbol is only used where one or more complete paragraphs have been deleted.
- ▶ A “Δ” represents partial text deletions and or figure/table revisions somewhere in the text. There’s no specific indication of which word, group of words, or a sentence was deleted.

How to Locate a Specific Requirement

How to go about finding what you’re looking for in the *Code* book depends, to some degree, on your experience with the *NEC*. Experts typically know the requirements so well that they just go to the correct rule. Very experienced people might only need the Table of Contents to locate the requirement for which they’re looking. On the other hand, average users should use all the tools at their disposal, including the Table of Contents, the Index, and the search feature on electronic versions of the *Code* book.

Let’s work through a simple example: What *NEC* rule specifies the maximum number of disconnects permitted for a service?

Using the Table of Contents. If you’re an experienced *Code* user, you might use the Table of Contents. You’ll know Article 230 applies to “Services,” and because this article is so large, it’s divided up into multiple parts (eight parts to be exact). With this knowledge, you can quickly go to the Table of Contents and see it lists the Service Equipment Disconnecting Means requirements in Part VI.

Author’s Comment:

- ▶ The number “70” precedes all page numbers in this standard because the *NEC* is NFPA Standard Number 70.

Using the Index. If you use the Index (which lists subjects in alphabetical order) to look up the term “service disconnect,” you’ll see there’s no listing. If you try “disconnecting means,” then “services,” you’ll find that the Index indicates the rule is in Article 230, Part VI. Because the *NEC* doesn’t give a page number in the Index, you’ll need to use the Table of Contents to find it, or flip through the *Code* book to Article 230, then continue to flip through pages until you find Part VI.

Many people complain that the *NEC* only confuses them by taking them in circles. Once you gain experience in using the *Code* and deepen your understanding of words, terms, principles, and practices, you’ll find it much easier to understand and use than you originally thought.

With enough exposure in the use of the *NEC*, you’ll discover that some words and terms are often specific to certain articles. The word “solar”

for example will immediately send experienced *Code* book users to Article 690—Solar Photovoltaic (PV) Systems. The word “marina” suggests what you seek might be in Article 555. There are times when a main article will send you to a specific requirement in another one in which compliance is required in which case it will say (for example), “in accordance with 230.xx.” Don’t think of these situations as a “circle,” but rather a map directing you to exactly where you need to be.

Customizing Your *Code* Book

One way to increase your comfort level with your *Code* book is to customize it to meet your needs. You can do this by highlighting and underlining important *NEC* requirements. Preprinted adhesive tabs are also an excellent aid to quickly find important articles and sections that are regularly referenced. However, understand that if you’re using your *Code* book to prepare to take an exam, some exam centers don’t allow markings of any type. For more information about tabs for your *Code* book, visit MikeHolt.com/Tabs.

Highlighting. As you read through or find answers to your questions, be sure you highlight those requirements in the *NEC* that are the most important or relevant to you. Use one color, like yellow, for general interest and a different one for important requirements you want to find quickly. Be sure to highlight terms in the Index and the Table of Contents as you use them.

Underlining. Underline or circle key words and phrases in the *Code* with a red or blue pen (not a lead pencil) using a short ruler or other straightedge to keep lines straight and neat. This is a very handy way to make important requirements stand out. A short ruler or other straightedge also comes in handy for locating the correct information in a table.

Interpretations

Industry professionals often enjoy the challenge of discussing, and at times debating, the *Code* requirements. These types of discussions are important to the process of better understanding the *NEC* requirements and applications. However, if you decide you’re going to participate in one of these discussions, don’t spout out what you think without having the actual *Code* book in your hand. The professional way of discussing a requirement is by referring to a specific section rather than talking in vague generalities. This will help everyone involved clearly understand the point and become better educated. In fact, you may become so well educated about the *NEC* that you might even decide to participate in the change process and help to make it even better!

Become Involved in the NEC Process

The actual process of changing the *Code* takes about two years and involves hundreds of individuals trying to make the *NEC* as current and accurate as possible. As you advance in your studies and understanding of the *Code*, you might begin to find it very interesting, enjoy it more, and realize that you can also be a part of the process. Rather than sitting back and allowing others to take the lead, you can participate by making proposals and being a part of its development. For the 2023 cycle, there were over 4,000 Public Inputs and 1,956 Public Comments. This resulted in several new articles and a wide array of revised rules to keep the *NEC* up to date with new technologies and pave the way to a safer and more efficient electrical future.

Here's how the process works:

STEP 1—Public Input Stage

Public Input. The revision cycle begins with the acceptance of Public Input (PI) which is the public notice asking for anyone interested to submit input on an existing standard or a committee-approved new draft standard. Following the closing date, the committee conducts a First Draft Meeting to respond to all Public Inputs.

First Draft Meeting. At the First Draft (FD) Meeting, the Technical Committee considers and provides a response to all Public Input. The Technical Committee may use the input to develop First Revisions to the standard. The First Draft documents consist of the initial meeting consensus of the committee by simple majority. However, the final position of the Technical Committee must be established by a ballot which follows.

Committee Ballot on First Draft. The First Draft developed at the First Draft Meeting is balloted. In order to appear in the First Draft, a revision must be approved by at least two-thirds of the Technical Committee.

First Draft Report Posted. First revisions which pass ballot are ultimately compiled and published as the First Draft Report on the document's NFPA web page. This report serves as documentation for the Input Stage and is published for review and comment. The public may review the First Draft Report to determine whether to submit Public Comments on the First Draft.

STEP 2—Public Comment Stage

Public Comment. Once the First Draft Report becomes available, there's a Public Comment period during which anyone can submit a Public Comment on the First Draft. After the Public Comment closing date, the Technical Committee conducts/holds their Second Draft Meeting.

Second Draft Meeting. After the Public Comment closing date, if Public Comments are received or the committee has additional proposed revisions, a Second Draft Meeting is held. At the Second Draft Meeting, the Technical Committee reviews the First Draft and may make additional revisions to the draft Standard. All Public Comments are considered, and the Technical Committee provides an action and response to each Public Comment. These actions result in the Second Draft.

Committee Ballot on Second Draft. The Second Revisions developed at the Second Draft Meeting are balloted. To appear in the Second Draft, a revision must be approved by at least two-thirds of the Technical Committee.

Second Draft Report Posted. Second Revisions which pass ballot are ultimately compiled and published as the Second Draft Report on the document's NFPA website. This report serves as documentation of the Comment Stage and is published for public review.

Once published, the public can review the Second Draft Report to decide whether to submit a Notice of Intent to Make a Motion (NITMAM) for further consideration.

STEP 3—NFPA Technical Meeting (Tech Session)

Following completion of the Public Input and Public Comment stages, there's further opportunity for debate and discussion of issues through the NFPA Technical Meeting that takes place at the NFPA Conference & Expo®. These motions are attempts to change the resulting final Standard from the committee's recommendations published as the Second Draft.

STEP 4—Council Appeals and Issuance of Standard

Issuance of Standards. When the Standards Council convenes to issue an NFPA standard, it also hears any related appeals. Appeals are an important part of assuring that all NFPA rules have been followed and that due process and fairness have continued throughout the standards development process. The Standards Council considers appeals based on the written record and by conducting live hearings during which all interested parties can participate. Appeals are decided on the entire record of the process, as well as all submissions and statements presented.

After deciding all appeals related to a standard, the Standards Council, if appropriate, proceeds to issue the Standard as an official NFPA Standard. The decision of the Standards Council is final subject only to limited review by the NFPA Board of Directors. The new NFPA standard becomes effective twenty days following the Standards Council's action of issuance.

Temporary Interim Amendment—(TIA)

Sometimes, a change to the *NEC* is of an emergency nature. Perhaps an editing mistake was made that can affect an electrical installation to the extent it may create a hazard. Maybe an occurrence in the field created a condition that needs to be addressed immediately and can't wait for the normal *Code* cycle and next edition of the standard. When these circumstances warrant it, a TIA or "Temporary Interim Amendment" can be submitted for consideration.

The NFPA defines a TIA as, "tentative because it has not been processed through the entire standards-making procedures. It is interim because it is effective only between editions of the standard. A TIA automatically becomes a Public Input of the proponent for the next edition of the standard; as such, it then is subject to all of the procedures of the standards-making process."

Author's Comment:

- Proposals, comments, and TIAs can be submitted for consideration online at the NFPA website, www.nfpa.org. From the homepage, look for "Codes & Standards," then find "Standards Development," and click on "How the Process Works." If you'd like to see something changed in the *Code*, you're encouraged to participate in the process.

CONTINUING EDUCATION MADE EASY


Why should you choose a Mike Holt Course?

- Available in Online and Live Class Options
- Online Courses are Convenient and Easy-to-Use
- Excellent Customer Support
- Approved Across the U.S.

Save 20% on all CEU Courses
Use Discount Code NDX23

Visit: MikeHolt.com/CEU

Special cannot be combined with any other offer, or applied to previous orders

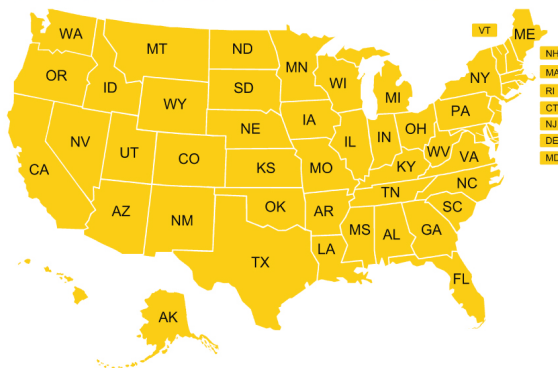

Very clearly written and easy to understand. Best NEC® course I have seen during my 35 year career in the industry.

J. Warren.

INDEX

Description	Rule	Description	Rule
A			
Agricultural Buildings		Storage Water Heaters	422.13
Corrosive Atmosphere	547.24	Support of Ceiling-Suspended (Paddle) Fans	422.18
Damp or Wet Locations	547.23		
Equipment Enclosures, Boxes, Conduit Bodies, and Fittings	547.22	Armored Cable (Type AC)	
Equipment Grounding Conductor	547.27	Bending Radius	320.24
Equipotential Planes	547.44	Boxes and Fittings	320.40
Flexible Connections	547.25	Conductor Ampacity	320.80
GFCI Protection of Receptacles	547.28	Construction	320.100
Luminaires	547.31	Equipment Grounding Conductor	320.108
Physical Protection	547.26	Exposed Work	320.15
Wiring Methods	547.20	In Roof Spaces	320.23
		Listing Requirements	320.6
		Securing and Supporting	320.30
		Through or Parallel to Framing Members	320.17
		Uses Not Permitted	320.12
		Uses Permitted	320.10
Air-Conditioning Equipment		Assembly Occupancies	
Bathtub and Shower Space	440.8	General Classifications	518.2
Conductor Ampacity	440.33	Illumination	518.6
Disconnect General	440.11	Temporary Wiring	518.3
Disconnect Location	440.14	Wiring Methods	518.4
Equipment Grounding Conductor	440.9		
Marking on Hermetic Motor-Compressors and Equipment	440.4	Audio Signal Amplification and Reproduction Equipment	
Short-Circuit and Ground-Fault Protective Device Size	440.22	Access to Electrical Equipment Behind Panels	640.5
		Audio Systems Near Bodies of Water	640.10
		Conduit or Tubing	640.23
		Locations and Other Articles	640.3
		Mechanical Execution of Work	640.6
		Protection of Electrical Equipment	640.4
		Use of Flexible Cords and Flexible Cables	640.21
		Wiring Methods	640.9
Antenna Systems			
Antenna Discharge Unit	810.20		
Avoid Contact with Conductors of Other Systems	810.13		
Bonding Conductors and Grounding Electrode Conductors	810.21		
Clearances	810.18		
Metal Antenna Supports—Bonding	810.15		
Appliances			
Branch Circuits	422.10		
Central Heating Equipment	422.12		
Cord-and-Plug-Connected Disconnect Appliances	422.33		
Disconnect—General	422.30		
Flexible Cords	422.16		
Listing Required	422.6		
Outlet Boxes to be Covered	422.20		
Overcurrent Protection	422.11		
Permanently Connected Appliance Disconnects	422.31		
		B	
		Boxes, Conduit Bodies, and Handhole Enclosures	
		Box Requirements	314.27
		Cables That Enter Boxes	314.17
		Flush-Mounted Boxes	314.20
		Handhole Enclosures	314.30

Description	Rule	Description	Rule
Metal Boxes	314.4	Cable Trays	
Nonmetallic Boxes	314.3	Bushed Conduit and Tubing	392.46
Outlet Box Sizing	314.16	Cable and Conductor Installation	392.20
Pull Boxes, Junction Boxes, and Conduit Bodies	314.28	Cable Splices	392.56
Repairing Noncombustible Surfaces	314.21	Cable Tray Installations	392.18
Screws or Other Fasteners	314.5	Equipment Grounding Conductor	392.60
Securing Boxes	314.23	Expansion Splice Plates	392.44
Surface Extensions	314.22	Securing and Supporting	392.30
Wet Locations	314.15	Uses Not Permitted	392.12
Wiring to be Accessible	314.29	Uses Permitted	392.10
Branch Circuits		Cables for Power-Limited Circuits	
Arc-Fault Circuit-Interrupter Protection	210.12	Abandoned Cable	722.25
Branch Circuits Required	210.11	Electrical Equipment Behind Access Panels	722.21
Branch-Circuit Voltage	210.6	Installation of Power-Limited Cables	722.135
Conductor Identification	210.5	Listing and Marking of Power-Limited Cables	722.179
Conductor Sizing	210.19	Mechanical Execution of Work	722.24
GFCI Protection	210.8		
Guest Rooms and Guest Suites	210.17	Carnivals, Circuses, Fairs, and Similar Events	
Multiple Branch Circuits	210.7	GFCI-Protected Receptacles and Equipment	525.23
Multiple-Outlet Branch Circuits	210.23	Outdoor Portable Distribution or Termination Boxes	525.22
Multiwire Branch Circuits	210.4	Overhead Conductor Clearances	525.5
Other Articles	210.3	Portable Equipment Grounding Conductor Continuity	525.32
Overcurrent Protection	210.20	Protection of Electrical Equipment	525.6
Receptacle Rating	210.21	Rides, Tents, and Concessions	525.21
		Wiring Methods	525.20
Buildings Supplied by a Feeder		Class I Hazardous Locations	
Disconnecting Means	225.31	Conductor Insulation	501.20
Emergency (Shutoff) Disconnects	225.41	Conduit and Cable Seals	501.15
Grouping of Disconnects	225.34	Enclosures Containing Make-and-Break Contact Devices	501.115
Identification of Multiple Supplies	225.37	Flexible Cords, Class I, Divisions 1 and 2	501.140
Maximum Number of Disconnects	225.33	Grounding and Bonding	501.30
Number of Supplies	225.30	Luminaires	501.130
Rating of Disconnecting Means	225.39	Motors and Generators	501.125
Surge Protection	225.42	Receptacles	501.145
		Utilization Equipment	501.135
		Wiring Methods	501.10
Cabinets, Cutout Boxes, and Meter Socket Enclosures		Class II Hazardous Locations	
Cable Termination to Enclosures	312.5	Enclosures Containing Make-and-Break Contacts	502.115
Damp or Wet Locations	312.2	Explosionproof Equipment	502.5
Deflection of Conductors	312.6	Flexible Cords	502.140
Enclosure Material	312.100	Grounding and Bonding	502.30
Overcurrent Device Enclosures	312.8	Luminaires	502.130
Position in Walls	312.3	Motors and Generators	502.125
Repairing Gaps in Noncombustible Surfaces	312.4	Receptacles and Attachment Plugs	502.145
Screws or Other Fasteners	312.10	Sealing	502.15
		Utilization Equipment	502.135
		Wiring Methods	502.10

Description	Rule	Description	Rule
Class 1 Power-Limited Circuits		Communications Systems	
Class 1 Circuit Conductors	724.49	Abandoned Cable	800.25
Class 1 Circuit Identification	724.30	Access to Electrical Equipment Behind Panels	800.21
Class 1 Circuit Overcurrent Protection	724.43	Installation of Coaxial Cables and Equipment	800.133
Class 1 Circuit Overcurrent Protective Device Location	724.45	Installation of Communications Wires, Cables, and Raceways	800.113
Class 1 Circuit Wiring Methods	724.46	Listed Communications Wires, Coaxial Cables, and Raceways	800.154
Class 1 Power Source	724.40	Mechanical Execution of Work	800.24
Conductors of Different Circuits	724.48	Plenum Cable Ties	800.170
Number of Conductors in a Raceway	724.51	Raceways	800.110
Class 2 Power-Limited Circuits		Separation from Lightning Conductors	800.53
Bundling Cables Transmitting Power and Data	725.144	Spread of Fire or Products of Combustion	800.26
Conductors of Different Circuits	725.139	Conductors for General Wiring	
Power Sources for Class 2 Circuits	725.60	Ampacities for Conductors Rated 0V to 2000V	310.14
Safety-Control Equipment	725.31	Ampacities of Insulated Conductors	310.16
Separation from Power Conductors	725.136	Ampacity Tables	310.15
Wiring Methods on Load Side of the Class 2 Power Source	725.130	Conductor Construction and Application	310.4
Wiring Methods on Supply Side of the Class 2 Power Source	725.127	Conductor Identification	310.6
Commercial Repair and Storage Garages		Conductors, Minimum Size and Material	310.3
Classification of Hazardous Areas	511.3	Dwelling Services and Feeders	310.12
GFCI-Protected Receptacles	511.12	Uses Permitted	310.10
Seals	511.9	E	
Special Equipment	511.10	Electric Signs	
Wiring and Equipment Above Hazardous Locations	511.7	Ballasts, Transformers, Class 2 Power-Limited Power Sources	600.21
Wiring Below Hazardous (Classified) Locations	511.8	Branch Circuits	600.5
		Class 2 Power-Limited Power Sources	600.24
		Disconnecting Means	600.6
		Grounding and Bonding	600.7
		Listing	600.3
		Location	600.9
		Markings	600.4



Use Discount Code NDX23
MikeHolt.com/Code

Discount applies to Mike Holt Code products

Electric Vehicle Power Transfer System

Disconnecting Means	625.43
Electric Vehicle Branch Circuit	625.40
GFCI	625.54
Interactive Equipment	625.48
Island Mode	625.49
Listed	625.6
Load	625.42
Overcurrent Protection	625.41
Ventilation	625.52
Wireless Power Transfer Equipment Grounding	625.101
Wireless Power Transfer Equipment Installation	625.102

Description	Rule	Description	Rule
Electric Welders			
Arc Welders			
Arc Welders—Ampacity of Supply Conductors	630.11	Emergency Illumination	700.16
Arc Welders—Disconnecting Means	630.13	Loads on Emergency Branch Circuits	700.15
Arc Welders—Overcurrent Protection	630.12	Multiwire Branch Circuits	700.19
Grounding of Welder Secondary Circuit	630.15	Overcurrent Protection Accessibility	700.30
Listing	630.6	Selective Coordination	700.32
Receptacle, GFCI Protection	630.8	Signals	700.6
		Signs	700.7
		Surge Protection	700.8
		Tests and Maintenance	700.3
		Transfer Switch	700.5
		Wiring to Emergency Loads	700.10
		Wiring, Class 2-Powered Emergency Lighting Systems	700.11
Resistance Welders			
Resistance Welders—Ampacity of Supply Conductor	630.31		
Resistance Welders—Disconnecting Means	630.33		
Resistance Welders—Overcurrent Protection	630.32		
Electrical Metallic Tubing (EMT)		Energy Storage Systems	
Bends	358.24	Circuit Current Rating	706.30
Couplings and Connectors	358.42	Commissioning and Maintenance	706.7
Equipment Grounding Conductor	358.60	Disconnect	706.15
Listing Requirements	358.6	ESS in Parallel with Other Sources of Power	706.16
Number of Conductors	358.22	Listing	706.5
Reaming	358.28	Multiple Systems	706.6
Securing and Supporting	358.30	Overcurrent Protection	706.31
Trade Size	358.20	Qualified Personnel	706.3
Uses Not Permitted	358.12	System Nameplate Requirements	706.4
Uses Permitted	358.10		
Electrical Nonmetallic Tubing (ENT)			
Bends	362.24		
Bushings	362.46		
Equipment Grounding Conductor	362.60		
Joints	362.48		
Listing	362.6		
Number of Conductors	362.22		
Securing and Supporting	362.30		
Trade Sizes	362.20		
Trimming	362.28		
Uses Not Permitted	362.12		
Uses Permitted	362.10		
Elevators			
Branch Circuit for Hoistway Pit Lighting and Receptacles	620.24		
Branch Circuits for Elevator Car(s)	620.22		
Branch Circuits for Machine Room/Machinery Space	620.23		
Disconnecting Means	620.51		
GFCI Protection for Receptacles	620.6		
Wiring in Elevator Hoistways, Control, and Machine Rooms	620.37		
Emergency Systems			
Capacity and Rating	700.4		
Class 2 Powered Emergency Lighting Systems	700.27		
		Feeders	
		Barriers	215.15
		Conductor Identification	215.12
		Conductor Sizing	215.2
		Feeder Equipment Grounding Conductor	215.6
		Ground-Fault Protection of Equipment	215.10
		Overcurrent Protection Sizing	215.3
		Surge Protection	215.18
		Fire Alarm Systems	
		Abandoned Cables	760.25
		Access to Electrical Equipment Behind Panels	760.21
		Fire Alarm Circuit Identification	760.30
		Fire Alarm Circuit Requirements	760.35
		Load Side of the Power-Limited Fire Alarm Power Source	760.130
		Marking	760.124
		Mechanical Execution of Work	760.24
		Power Sources for Power-Limited Fire Alarm Equipment	760.121
		Separation from Power Conductors	760.136
		Supply-Side Overvoltage Protection	760.33
		Support of PLFA Cables	760.143
		Wiring Methods on Supply Side of the PLFA Source	760.127

Description	Rule	Description	Rule
Fire Pumps		Flexible Cords	
Continuity of Power	695.4	Ampacity of Flexible Cords	400.5
Control Wiring	695.14	Protection from Damage	400.17
Electric Power Source(s)	695.3	Pull at Joints and Terminals	400.14
Equipment Location	695.12	Splices	400.13
Fire Pump Controller Voltage Drop	695.7	Suitability	400.3
Listed Equipment	695.10	Types of Flexible Cords	400.4
Power Wiring	695.6	Uses Not Permitted	400.12
Surge Protection	695.15	Uses Permitted	400.10
Transformers	695.5		
Fixed Electric Space-Heating Equipment		Flexible Metal Conduit (FMC)	
Branch Circuits	424.4	Bends	348.24
Disconnecting Means	424.19	Couplings and Connectors	348.42
Location of Disconnecting Means for Electric Duct Heater	424.65	Equipment Grounding and Bonding Conductors	348.60
Other Articles	424.3	Listing Requirements	348.6
		Number of Conductors	348.22
Fixture Wires		Securing and Supporting	348.30
Ampacity of Fixture Wires	402.5	Trade Size	348.20
Minimum Size	402.6	Trimming	348.28
Neutral Conductor	402.8	Uses Not Permitted	348.12
Other Articles	402.2	Uses Permitted	348.10
Raceway Size	402.7		
Types	402.3		
Uses Not Permitted	402.12		
Uses Permitted	402.10		



Have an NEC® Question?
Join the Mike Holt Code Community

Forum Topics include:
NEC® | Electrical Calculations | Engineering |
Business Management | Estimating | Bonding and
Grounding | Limited Energy | Education | Safety

MikeHolt.com/Forum

G

General Requirements for Electrical Installations


Approval of Conductors and Equipment	110.2
Arc-Flash Hazard Warning Label, Other Than Dwelling Units	110.16
Available Fault Current Marking	110.24
Boxes or Fittings, Splices and Terminations	300.15
Code Arrangement	90.3
Conductor Length at Boxes	300.14
Conductor Material	110.5
Conductor Sizes	110.6
Conductor Termination and Splicing	110.14
Conductors	300.3
Deteriorating Agents	110.11
Electrical Continuity	300.10
Equipment Short-Circuit Current Rating	110.10
Examination of Equipment for Safety	90.7
Exit Stair Towers	300.25
Hazard Markings	110.21
High-Leg Conductor Identification	110.15
Identification of Disconnecting Means	110.22
Interrupting Rating of Overcurrent Protective Devices	110.9
Lockable Disconnecting Means	110.25
Mandatory Requirements and Explanatory Material	90.5
Mechanical and Electrical Continuity of Conductors	300.13
Mechanical Continuity	300.12

Description	Rule	Description	Rule
Mechanical Execution of Work	110.12		
Mounting and Cooling of Equipment	110.13		
NEC Enforcement	90.4		
NEMA Enclosure Types	110.28		
Number and Size of Conductors in a Raceway	300.17		
Panels Designed to Allow Access	300.23		
Protection Against Corrosion	300.6		
Protection Against Physical Damage	300.4		
Protection Against Physical Damage	110.27		
Raceway Installations	300.18		
Raceways Exposed to Different Temperatures	300.7		
Raceways in Wet Locations Above Grade	300.9		
Reconditioned Equipment	110.20		
Reducing Inductive Heating	300.20		
Securing and Supporting	300.11		
Servicing and Maintenance of Equipment	110.17		
Spaces Around Electrical Equipment	110.26		
Spread of Fire or Products of Combustion	300.21		
Suitable Wiring Methods	110.8		
Supporting Conductors in Vertical Raceways	300.19		
Underground Installations	300.5		
Use and Application of the NEC	90.2		
Use of Equipment	110.3		
Wiring in Ducts and Plenum Spaces	300.22		
Wiring Integrity	110.7		
Generators		Identification Equipment Grounding Conductors	250.119
Conductor Ampacity	445.13	Metal Enclosures, Effective Ground-Fault Current Path	250.109
Emergency Shutdown of Prime Mover	445.19	Sizing Wire-Type Equipment Grounding Conductors	250.122
Listing	445.6	Types of Equipment Grounding Conductors	250.118
Marking	445.11	Equipment Grounding Conductor Connections	
Grounding and Bonding		Connecting Receptacle Grounding Terminal	250.146
Bonding		Continuity of Equipment Grounding Conductors in Boxes	250.148
Bonding for Communications Systems	250.94	Cord-and-Plug-Connected	250.138
Bonding in Hazardous (Classified) Locations	250.100	Equipment Connected by Permanent Wiring Methods	250.134
Bonding Jumper Sizing	250.102	Frames of Ranges, Ovens, and Clothes Dryers	250.140
Bonding Loosely Jointed Metal Raceways	250.98	General	
Bonding Metal Raceways/ Cables, 277V/480V Circuits	250.97	Buildings Supplied by a Feeder	250.32
Bonding Metal Service Raceways and Enclosures	250.92	Clean Surfaces	250.12
Bonding of Piping Systems and Exposed Structural Metal	250.104	Connection of Grounding and Bonding Conductors	250.8
Lightning Protection Systems	250.106	Impedance Grounded Systems—480V to 1000V	250.36
Enclosure and Raceway		Objectionable Current	250.6
Other than Service Enclosures and Raceways	250.86	Performance Requirements for Grounding and Bonding	250.4
Service Raceways and Enclosures	250.80	Protection of Ground Clamps and Fittings	250.10
Equipment Grounding Conductors		System Grounding and Bonding	
Equipment Connected by Cord and Plug	250.114	Generator Separately Derived Systems	250.30
Equipment Grounding Conductor Installation	250.120	Main Bonding Jumper and System Bonding Jumper	250.28
		Service Grounding	250.24
		Systems Required to be Grounded	250.20
		Transformer Separately Derived Systems	250.30
		Ungrounded Systems	250.21

Description	Rule	Description	Rule
Grounding Electrode System and Grounding Electrode Conductor		Unbalanced Interconnections	705.45
Auxiliary Grounding Electrodes	250.54	Wiring Methods	705.25
Grounding Electrode Conductor	250.62	Intermediate Metal Conduit (IMC)	
Grounding Electrode Conductor Connection	250.68	Bends	342.24
Grounding Electrode Conductor Installation	250.64	Bushings	342.46
Grounding Electrode Conductor Termination Fittings	250.70	Couplings and Connectors	342.42
Grounding Electrode Installation	250.53	Dissimilar Metals	342.14
Grounding Electrode System	250.50	Equipment Grounding Conductor	342.60
Grounding Electrode Types	250.52	Listing Requirements	342.6
Lightning Protection Electrode	250.60	Number of Conductors	342.22
Sizing Grounding Electrode Conductors	250.66	Reaming	342.28
H		Securing and Supporting	342.30
Hazardous (Classified) Locations		Trade Size	342.20
Classifications of Hazardous (Classified) Locations	500.5	Uses Permitted	342.10
Documentation	500.4	L	
Equipment	500.8	Large-Scale Photovoltaic (PV) Electric Supply Stations	
Material Groups	500.6	Conformance of Construction to Engineered Design	691.7
Protection Techniques	500.7	Direct-Current Operating Voltage	691.8
Health Care Facilities		Disconnect for Isolating Photovoltaic Equipment	691.9
Applicability	517.10	Engineered Design	691.6
Category 2 Spaces	517.18	Equipment	691.5
Equipment Grounding Conductor in Patient Care Spaces	517.13	Fence Bonding and Grounding	691.11
Isolated Ground Receptacles	517.16	Fire Mitigation	691.10
Wiring Methods	517.12	Special Requirements	691.4
I		Legally Required Standby Systems	
Information Technology Equipment (ITE)		Capacity and Rating	701.4
Disconnecting Means	645.10	Commissioning and Maintenance	701.3
Equipment Grounding and Bonding	645.15	Overcurrent Protection Accessibility	701.30
Special Requirements	645.4	Selective Coordination	701.32
Supply Circuits and Interconnecting Cables	645.5	Signals	701.6
Interconnected Electric Power Production Sources		Signs	701.7
Energy Management Systems	705.13	Transfer Switches	701.5
Equipment Approval	705.6	Wiring	701.10
Ground-Fault Protection	705.32	Liquidtight Flexible Metal Conduit (LFMC)	
Identification of Parallel Power Production Sources	705.10	Bends	350.24
Load-Side Source Connection	705.12	Equipment Grounding and Bonding Conductors	350.60
Loss of Primary Source	705.40	Listing Requirements	350.6
Output Current and Circuit Sizing	705.28	Number of Conductors	350.22
Overcurrent Protection	705.30	Securing and Supporting	350.30
Power Production Source Disconnect	705.20	Trade Size	350.20
Service Connection	705.11	Trimming	350.28
System Installation	705.8	Uses Not Permitted	350.12
		Uses Permitted	350.10

Description	Rule	Description	Rule
Liquidtight Flexible Nonmetallic Conduit (LFNC)		Specific Location Requirements	411.6
Bends	356.24	Voltage Limitations	411.3
Equipment Grounding Conductor	356.60	Luminaires	
Fittings	356.42	<i>Flush and Recessed Luminaires</i>	
Listing Requirements	356.6	Clearance and Installation	410.116
Number of Conductors	356.22	Temperature	410.115
Securing and Supporting	356.30	<i>General</i>	
Trade Size	356.20	Connection of Electric-Discharge and LED Luminaires	410.24
Uses Not Permitted	356.12	Connection to the Equipment Grounding Conductor	410.44
Uses Permitted	356.10	Cord-Connected Luminaires	410.62
Load Calculations		Disconnecting Means for Fluorescent or LED Luminaires	410.71
<i>General</i>		Listing Required	410.6
Application of Other Articles	220.3	Luminaires in Clothes Closets	410.16
Calculations	220.5	Luminaires in Specific Locations	410.10
Maximum Load	220.11	Means of Support	410.36
Other Loads—Occupancies	220.14	Outlet Boxes to be Covered	410.22
<i>Optional Method</i>		Supports	410.30
Determining Existing Loads	220.87	<i>Horticultural Lighting Equipment</i>	
Optional Load Calculations, Dwellings	220.82	Equipment Grounding Conductor	410.182
Optional Load Calculations, Multifamily	220.84	Fittings and Connectors	410.180
Optional Load Calculations, Two-Family Dwelling Units	220.85	Flexible Cord	410.178
<i>Standard Method</i>		General	410.170
Appliance Demand Load, Dwelling	220.53	GFCI and Special Purpose GFCI Protection	410.184
Clothes Dryer Demand Load, Dwelling	220.54	Installation and Use	410.174
Cooking Appliances in Dwelling Units	220.55	Listing	410.172
Dwelling Unit(s), Load Calculation	220.41	Locations Not Permitted	410.176
Electric Vehicle Supply Equipment Load	220.57	Support	410.186
Energy Management Systems	220.70	<i>Track Lighting</i>	
Fixed Electric Space-Heating Load	220.51	Fastening	410.154
General	220.40	Installation	410.150
General Lighting Demand Factors	220.45		
Hotel and Motel Occupancies	220.44		
Kitchen Equipment Load, Commercial	220.56		
Lighting Load for Non-Dwelling Occupancies	220.42		
Motor and Air-Conditioning Loads	220.50		
Neutral Calculated Load	220.61		
Noncoincident Loads	220.60		
Office Buildings	220.43		
Receptacle Demand Load, Commercial	220.47		
Show-Window and Track Lighting Loads, Commercial	220.46		
Small-Appliance and Laundry Loads, Dwelling	220.52		
M			
Low-Voltage Lighting		Manufactured Wiring Systems	
Branch Circuit	411.8	Installation—Securing and Supporting	604.7
Listing Required	411.2	Listing Requirements	604.6
Low-Voltage Lighting Systems	411.4	Uses Permitted	604.10
		Marinas, Boatyards, and Docking Facilities	
		Electric Shock Hazard Sign	555.10
		Electrical Datum Plane Distances	555.3
		Electrical Equipment and Connections	555.30
		Equipment Grounding Conductor	555.37
		Ground-Fault Protection (GFPE and GFCI)	555.35
		Location of Service Equipment	555.4
		Luminaires	555.38
		Motor Fuel Dispensing Stations	555.11
		Receptacles	555.33

Description	Rule	Description	Rule
Repair Facilities—Hazardous (Classified) Locations	555.12	Microgrid Systems	
Replacement of Equipment	555.15	Connections to the Primary Source	705.60
Shore Power Receptacle Disconnecting Means	555.36	Microgrid Control System (MCS)	705.76
Transformers	555.7	Microgrid Interconnect Devices (MID)	705.70
Wiring Methods and Installation	555.34	Microgrid System Operation	705.50
Metal Wireways		Motor Circuits, Controllers, and Adjustable-Speed Drives	
Conductors Connected in Parallel	376.20	<i>Adjustable-Speed Drive Systems</i>	
Equipment Grounding Conductor	376.60	Branch-Circuit Short-Circuit and Ground-Fault Protection	430.130
Number of Conductors and Ampacity	376.22	Conductor Ampacity	430.122
Size of Conductors	376.21	Disconnecting Means	430.128
Splices, Taps, and Power Distribution Blocks	376.56	General	430.120
Supports	376.30	Overload Protection	430.124
Uses Not Permitted	376.12	<i>Branch-Circuit Short-Circuit and Ground-Fault Protection</i>	
Uses Permitted	376.10	Branch-Circuit Short-Circuit and Ground-Fault Protection	430.52
Wireway Sizing	376.23	Combined Overcurrent Protective Device	430.55
Metal-Clad Cable (Type MC)		General	430.51
Bending Radius	330.24	Motor Feeder Protection	430.62
Conductor Ampacities	330.80	<i>Disconnecting Means</i>	
Equipment Grounding Conductor	430.108	Disconnect Location	430.102
Exposed Work	330.15	Motor or Controller Disconnect, Readily Accessible	430.107
In Roof Spaces	330.23	Type of Disconnecting Means	430.109
Listing Requirements	330.6	<i>General</i>	
Securing and Supporting	330.30	Highest Rated Motor	430.17
Through or Parallel to Framing Members	330.17	Location of Motors	430.14
Uses Not Permitted	330.12	Motor Conductor Ampacity	430.22
Uses Permitted	330.10	Motor Table FLC versus Motor Nameplate Current Rating	430.6
		Overload Protection	430.31
		Overload Protection for Continuous-Duty Motors	430.32
		Several Motors—Conductor Ampacity	430.24
		<i>Motor Control Circuits</i>	
		Disconnect for Control Circuits	430.75
		Motor Controller Horsepower Rating	430.83
		Overcurrent Protection for Control Circuits	430.72
		Motor Fuel Dispensing Facilities	
		Bonding Requirements	514.16
		Circuit Disconnects	514.11
		Classification of Locations	514.3
		Conduit Seal	514.9
		Underground Wiring	514.8
		Wiring and Equipment Above Hazardous Locations	514.7
		Wiring and Equipment Within Hazardous Locations	514.4
		Multioutlet Assemblies	
		Through Partitions	380.76
		Uses Not Permitted	380.12
		Uses Permitted	380.10

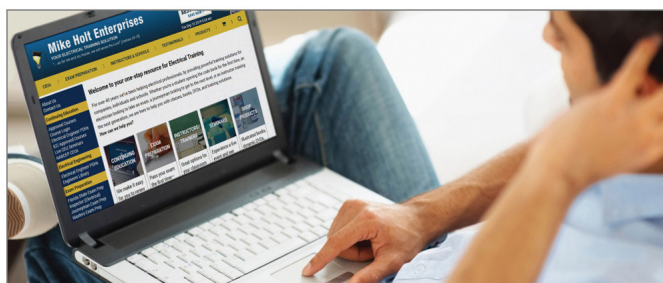

Visit MikeHolt.com

Discover lots of free resources:

Code Forum | Instructor Resources | Graphics |
Videos | Weekly Newsletters | & much more...

**The Most Informative Electrical
Resource on the Web Today**

Description	Rule	Description	Rule
N		O	
Neutral Conductor		Optical Fiber Cables	
General	200.2	Abandoned Cable	770.25
Identification of Neutral and Grounded Conductors	200.6	Access to Electrical Equipment Behind Panels	770.21
Neutral Conductor	200.4	Installation of Optical Fiber Cables and Electrical Conductors	770.133
Receptacle and Screw Shell Terminal	200.10	Mechanical Execution of Work	770.24
Use of White or Gray Color	200.7	Spread of Fire or Products of Combustion	770.26
Nonmetallic-Sheathed Cable (Type NM)		Optional Standby Systems	
Accessible Roof Spaces	334.23	Capacity and Rating	702.4
Bending Radius	334.24	Interconnection Equipment or Transfer Equipment	702.5
Boxes and Fittings	334.40	Outdoor Generators	702.12
Cables Entering Enclosures	334.19	Signs	702.7
Conductor Ampacity	334.80	Wiring	702.10
Equipment Grounding Conductor	334.108	Outside Branch Circuits and Feeders	
Exposed Work	334.15	Clearance for Overhead Conductors	225.18
Listing Requirements	334.6	Clearances from Buildings	225.19
Securing and Supporting	334.30	Masts as Supports	225.17
Through or Parallel to Framing Members	334.17	Minimum Conductor Size and Support	225.6
Type NM Cable, Uses Permitted	334.10	Raceway Seals	225.27
Uses Not Permitted	334.12	Raceways on Exterior Surfaces of Buildings	225.22
		Trees for Conductor Support	225.26



TAKING AN ELECTRICAL EXAM?

We can help...

Our best-selling exam preparation libraries have helped thousands of electricians across the country pass their exams.

Exam Prep libraries include:

- Theory
- Code
- Electrical Calculations
- Simulated Exams

Learn More - MikeHolt.com/ExamPrep



I thought it would be grueling studying for my exam, but after taking your courses I realized that it was uplifting and exciting.

Gary H.

Description	Rule	Description	Rule
Overcurrent Protection		Power and Control Tray Cable (Type TC)	
<i>Circuit Breakers</i>		Bending Radius	336.24
Applications	240.85	Listing Requirements	336.6
Arc-Energy Reduction—Circuit Breakers	240.87	Uses Not Permitted	336.12
Indicating	240.81	Uses Permitted	336.10
Markings	240.83		
Series Ratings	240.86		
<i>General</i>		R	
Arc-Energy Reduction—Fuses	240.67	Receptacle Outlets	
Edison-Base Fuses	240.51	Dwelling Unit Receptacle Outlet Requirements	210.52
Grounded-Phase Conductor on Overcurrent Device	240.22	Equipment Requiring Servicing	210.63
Ground-Fault Protection of Equipment	240.13	Lighting Outlet Requirements	210.70
Location of Overcurrent Protective Device in Circuit	240.21	Meeting Rooms	210.65
Location of Overcurrent Protective Devices	240.24	Receptacle Outlets	210.50
Other Articles (Overcurrent Protection of Equipment)	240.3	Receptacles in Guest Rooms and Suites, and Dormitory	210.60
Overcurrent Protection of Conductors	240.4	Show-Window Receptacles	210.62
Overcurrent Protection of Flexible Cords and Fixture Wires	240.5		
Overcurrent Protective Device, Handle Ties	240.15	Receptacles, Attachment Plugs, and Flanged Inlets	
Standard Ampere Ratings	240.6	Attachment Plugs and Flanged Surface Inlets	406.7
Supplementary Conductor Overcurrent Protection	240.10	Connecting Receptacle Grounding Terminal	406.11
Vertical Position, Enclosures	240.33	General Installation Requirements	406.4
		Receptacle Faceplates	406.6
		Receptacle Mounting	406.5
		Receptacle Rating and Type	406.3
		Receptacles in Damp or Wet Locations	406.9
		Tamper-Resistant Receptacles	406.12
		Rigid Metal Conduit (RMC)	
		Bends	344.24
		Bushings	344.46
		Couplings and Connectors	344.42
		Dissimilar Metals	344.14
		Equipment Grounding Conductor	344.60
		Listing Requirements	344.6
		Number of Conductors	344.22
		Reaming and Threading	344.28
		Securing and Supporting	344.30
		Trade Size	344.20
		Uses Permitted	344.10
		Rigid Polyvinyl Chloride Conduit (PVC)	
		Bends	352.24
		Bushings	352.46
		Equipment Grounding Conductor	352.60
		Expansion Fittings	352.44
		Joints	352.48
		Listing	352.6
		Number of Conductors	352.22
		Securing and Supporting	352.30
		Trade Size	352.20
P			
Panelboards			
Arrangement of Busbars and Conductors	408.3		
Circuit Directory and Description	408.4		
Clearance for Conductors Entering Bus Enclosures	408.5		
Clearances	408.18		
Enclosure	408.38		
Equipment Grounding Conductor	408.40		
Neutral Conductor Terminations	408.41		
Overcurrent Protection	408.36		
Panelboard Orientation	408.43		
Panelboard Rating	408.30		
Panelboards in Damp or Wet Locations	408.37		
Replacement Panelboards	408.9		
Short-Circuit Current Rating	408.6		
Unused Openings	408.7		

Description	Rule	Description	Rule
Trimming	352.28	Point of Attachment	230.26
Uses Not Permitted	352.12	Service Masts as Support	230.28
Uses Permitted	352.10	Vertical Clearance	230.24

S

Service-Entrance Cable (Types SE and USE)

Bending Radius	338.24
Listing Requirements	338.6
Uses Not Permitted	338.12
Uses Permitted	338.10

Services

General

Clearances on Buildings	230.9
Considered Outside a Building or Structure	230.6
Not to Pass Through a Building	230.3
Number of Services	230.2
Raceway Seals	230.8
Service Conductors Separate from Other Conductors	230.7
Vegetation as Support	230.10

Service Conductor/Overcurrent Protection

Location	230.91
Overload Protection—Where Required	230.90

Service Conductors—Overhead

Means of Attachment	230.27
Conductor Size and Rating	230.23

Service Conductors—Underground

Installation	230.30
Protection Against Damage	230.32
Underground Service Conductor Ampacity	230.31

Service-Entrance Conductors

Cable Supports	230.51
Conductor Sizing	230.42
High-Leg Conductor Identification	230.56
Number of Service-Entrance Conductor Sets	230.40
Overhead Service Locations	230.54
Protection Against Physical Damage	230.50
Raceways to Drain	230.53
Spliced and Tapped Connections	230.46
Wiring Methods	230.43

Service Disconnect

Supply Side of the Service Disconnect	230.82
Emergency (Shutoff) Disconnect	230.85
Grouping of Service Disconnects	230.72
Marking for Service Equipment	230.66
Number of Service Disconnects	230.71
Rating of Disconnect	230.79
Service Disconnect Requirements	230.70
Service Equipment—Barriers	230.62
Surge Protection	230.67

Solar Photovoltaic (PV) Systems

Access to Boxes	690.34
Alternating-Current Modules	690.6
Arc-Fault Circuit Protection	690.11
Circuit Current and Conductor Sizing	690.8
Component Interconnections	690.32
Connection to Other Power Sources	690.59
Connectors (Mating)	690.33
Equipment Grounding Conductor	690.43
Grounding Electrode System	690.47
Identification of Power Sources	690.56
Maximum PV System Direct-Current Circuit Voltage	690.7
Overcurrent Protection	690.9
PV Equipment Disconnect/Isolating Device	690.15
PV System DC Circuit Grounding and Protection	690.41
PV System Disconnect	690.13
Rapid Shutdown—PV Circuits on Building	690.12
Size of Equipment Grounding Conductors	690.45
Wiring Methods and Materials	690.31

UNDERSTANDING NEC® REQUIREMENTS FOR
SOLAR PHOTOVOLTAIC
AND ENERGY STORAGE SYSTEMS

MIKEHOLT.COM/SOLAR

Description	Rule	Description	Rule
Stand-Alone Systems		Hydromassage Bathtubs	
Equipment Approval	710.6	Accessibility	680.73
Identification of Power Sources	710.10	Equipotential Bonding	680.74
Stand-Alone Inverter Input Circuit Current	710.12	GFCI Protection	680.71
Wiring	710.15		
Stationary Standby Batteries		Permanently Installed Pools	
Battery and Cell Terminations	480.4	Equipotential Bonding	680.26
Battery Interconnections	480.12	Gas-Fired Water Heaters	680.28
Battery Locations	480.10	General	680.20
Battery Support Systems	480.9	Junction Box, Transformer, or GFCI Enclosure	680.24
		Pool Pump Motors	680.21
Surface Metal Raceways		Receptacles, Luminaires, and Switches	680.22
Equipment Grounding Conductor	386.60	Specialized Equipment	680.27
Listing Requirements	386.6	Underwater Pool Luminaires	680.23
Number of Conductors	386.22		
Securing and Supporting	386.30	Storable Pools	
Size of Conductors	386.21	GFCI Protection	680.32
Splices and Taps	386.56	Pumps	680.31
Uses Not Permitted	386.12	Receptacle Locations	680.34
Uses Permitted	386.10	Storable Pools	680.35
		Switches	
Swimming Pools, Hot Tubs, and Fountains		Accessibility and Grouping	404.8
Corrosive Environment	680.14	Bonding of Enclosures	404.12
Electric Pool Water Heaters and Heat Pumps	680.10	Circuit Breaker Enclosures	404.3
Equipment Disconnecting Means	680.13	Damp or Wet Locations	404.4
Equipment Rooms, Vaults, and Pits	680.12	General-Use Snap Switches	404.9
GFCI and SPGFCI Protection	680.5	Indicating	404.7
Grounding and Bonding	680.7	Mounting of Snap Switches	404.10
Inspections After Installation	680.4	Rating and Use of Snap Switches	404.14
Listing Requirements	680.6	Switch Connections	404.2
Overhead Conductor Clearance	680.9	Switch Marking	404.20
Underground Wiring	680.11		
Fountains		Temporary Installations	
Connection to an Equipment Grounding Conductor	680.54	All Wiring Installations	590.2
Cord-and-Plug-Connected Equipment	680.56	GFCI Protection for Personnel	590.6
Electric Signs in or Adjacent to Fountains	680.57	Listing of Decorative Lighting	590.5
GFCI or SPGFCI Protection for Nonsubmersible Pumps	680.59	Overcurrent Protective Devices	590.8
GFCI Protection of Receptacles	680.58	Time Constraints	590.3
Luminaires and Submersible Equipment	680.51		
Methods of Equipment Grounding	680.55	Transformers	
Hot Tubs		Disconnecting Means	450.14
Emergency Shutoff Equipment	680.41	Grounding and Bonding	450.10
GFCI or SPGFCI Protection	680.44	Primary Overcurrent Protection	450.3
Indoor Installations	680.43	Transformer Accessibility	450.13
Outdoor Installations	680.42	Ventilation	450.9
Permanently Installed Immersion Pools	680.45		

Description	Rule
-------------	------

U

Underground Feeder and Branch-Circuit Cable (Type UF)

Ampacity	340.80
Bends	340.24
Equipment Grounding Conductor	340.108
Insulation	340.112
Listing Requirements	340.6
Uses Not Permitted	340.12
Uses Permitted	340.10

LEARN THE 2023 CODE...



With one of Mike Holt's Best-Selling Code products

They take you step by step through
the National Electrical Code®

Now is the time to master the Code. Learn
from NEC® Expert Mike Holt, and gain
confidence when you're in the field. Choose
from one of these great programs:

- ☐ Understanding the NEC® Complete
Video Training Library
- ☐ Bonding and Grounding
Video Program
- ☐ Changes to the 2023 NEC®
Video Program
- ☐ Solar Photovoltaic and
Energy Storage Systems
Video Program

“You make it so easy to learn. The
videos are a must, and of course the
books just jump out at you. Keep up
the good work.” -Mark K.



Order Today & SAVE 20%

On any Mike Holt Code Product

Use Code: PDF23

Offer expires: 12/31/2023

MikeHolt.com/Code
or Call to Order 888.632.2633

 **Mike Holt Enterprises**

"...as for me and my house, we will serve the Lord." [Joshua 24:15]

Discounts apply to Mike Holt products only and
cannot be combined with any other offer